

Western Trent/Palmina Drinking Water System

Waterworks # 220008131
System Category – Large Municipal Residential

Annual Water Report

Prepared For: The City of Kawartha Lakes
Reporting Period of January 1st – December 31st 2021

Issued: February 4 2022

Operating Authority:



This report has been prepared to satisfy the annual reporting requirements in
O. Reg. 170/03 Section 11 and Schedule 22

Table of Contents

Annual Water Report	1
Report Availability	1
Compliance Report Card	1
System Process Description	2
Raw Source	2
Treatment	2
Treatment Chemicals used during the reporting year:	2
Summary of Non-Compliance.....	2
Adverse Water Quality Incidents	2
Non-Compliance.....	3
Non-Compliance Identified in a Ministry Inspection:	3
Flows	3
Raw Water Flows	3
Total Monthly Flows (m ³ /d)-Well #1	3
Monthly Rated Flows (L/s)-Well #1	4
4Total Monthly Flows (m ³ /d)-Well #2.....	4
4Monthly Rated Flows (L/s)-Well #2	5
Treated Water Flows	5
Monthly Rated Flows.....	5
Annual Total Flow Comparison	6
Regulatory Sample Results Summary	6
Microbiological Testing	6
Operational Testing	7
Inorganic Parameters	7
Schedule 15 Sampling:	8
Organic Parameters	8
Additional Legislated Samples	10
Major Maintenance Summary	10
WTRS Data Submission Confirmation.....	A

Report Availability

This system does not serve more than 10,000 residences. The annual reports will be available to residents free of charge at the City of Kawartha Lakes Public Works Administration Office and on [the city's website](#). The City of Kawartha Lakes Public Works Administration Office is located at 322 Kent Street West in Lindsay, Ontario.

Compliance Report Card

Drinking Water System Number: 220008131

Drinking Water System Name: Western Trent/Palmina DWS

Drinking Water System Owner: City of Kawartha Lakes

Drinking Water System Category: Large Municipal Residential

Reporting Period: January 1, 2021 - December 31, 2021

	# of Events	Date	Details
Health & Safety			
Number of Incidents	0		
Drinking Water			
MECP Inspections	1	June 24, 2021	Announced-Focused Drinking Water Inspection - Final Inspection Rating of 97.54%
AWQI's	0		
Number of Non-Compliances	1	April 1 – 6, 2021	72-hour trend review late
Number of Boil Water Advisories	0		

System Process Description

Raw Source

The Western Trent/Palmina Water Treatment Plant is supplied with raw groundwater from two GUDI wells: Well # 1 (Palmina Well) and Well # 2 (Western Trent Well).

Treatment

The treatment system consists of the following:

- Two drilled groundwater production wells deemed GUDI
- Raw and treated water flow meters
- Cartridge filtration system
- Chlorine contact chamber

- Treated water storage reservoir
- Two vertical turbine high lift pumps
- Chemical feed system consisting of four metering pumps for pre and post-chlorination and two sodium hypochlorite storage tanks with spill containment
- Standby power generator on site

Treatment Chemicals used during the reporting year:

Chemical Name	Use	Supplier
Sodium Hypochlorite	Disinfection	Brenntag

Summary of Non-Compliance

Adverse Water Quality Incidents

There were no adverse water quality incidents during the reporting period.

Non-Compliance

There was no non-compliance issues reported during the reporting period.

Non-Compliance Identified in a Ministry Inspection:

Legislation	Requirement(s) system failed to meet	Duration of the failure (i.e. date(s))	Corrective Action	Status
O. Reg. 170/03	72-hour review	Apr 1 – 6, 2021	Notified MECP when discovered. Additional training on 72-hour review requirement.	Complete

Flows


The Western Trent/Palmina Drinking Water System is operating on average under half the rated capacity.

Raw Water Flows

The Raw Water takings are regulated by the Permit to Take Water (PTTW). 2020 Raw Flow Data was submitted to the Ministry electronically under permit PTTW # 2180-B4CKK3. The confirmation for the data that was submitted is attached in Appendix A.


Total Monthly Flows (m³/d)

Max Allowable PTTW- Well #1

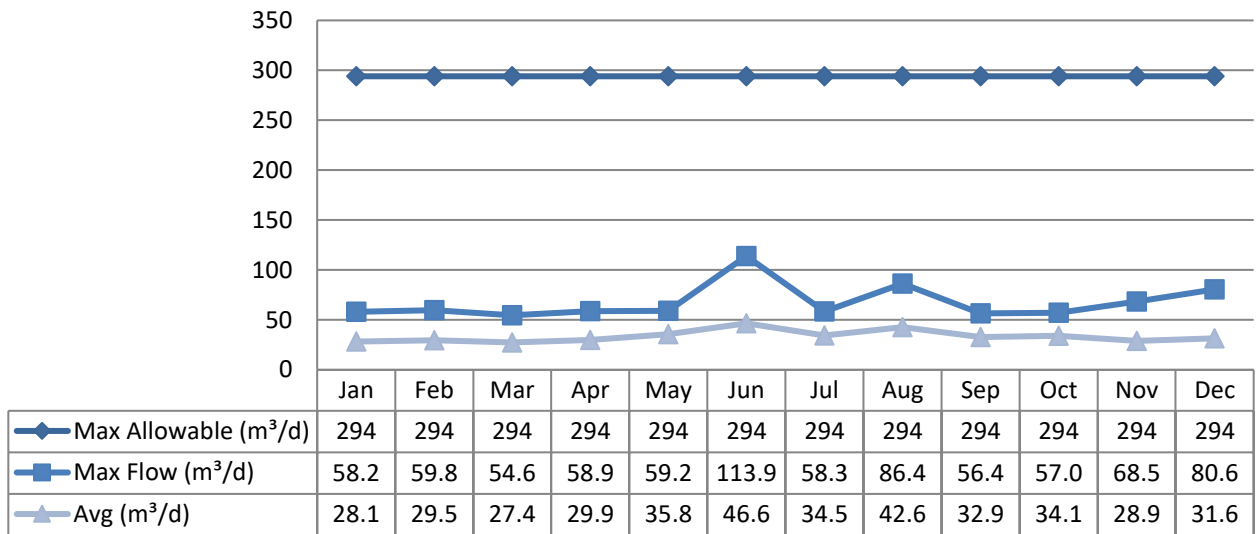

Monthly Rated Flows (L/s)


Max allowable rate – PTTW- Well #1

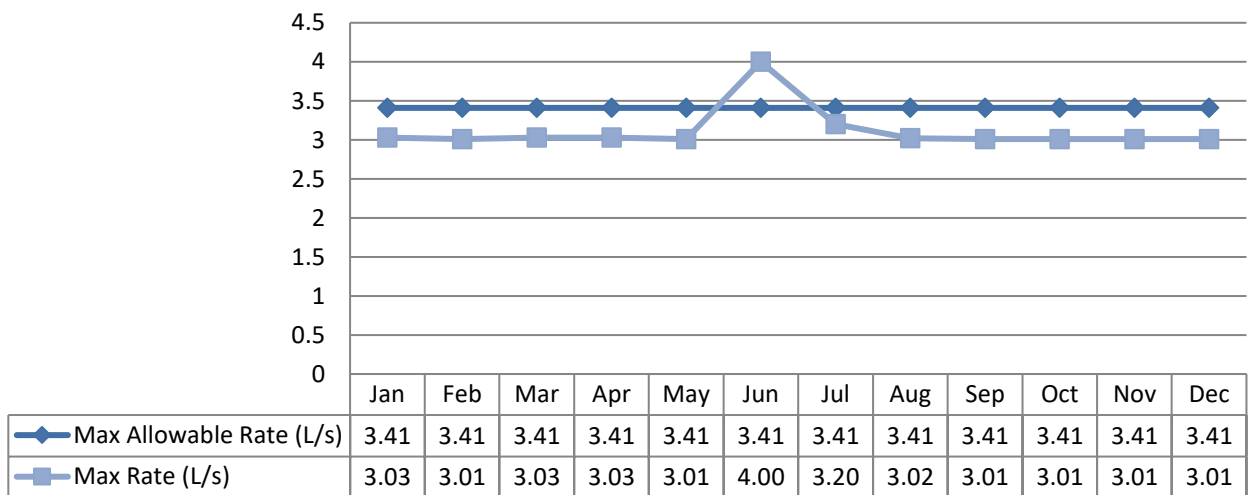


Note: Spike in June due to flow meter calibration.

Total Monthly Flows (m³/d)

Max Allowable PTTW- Well #2

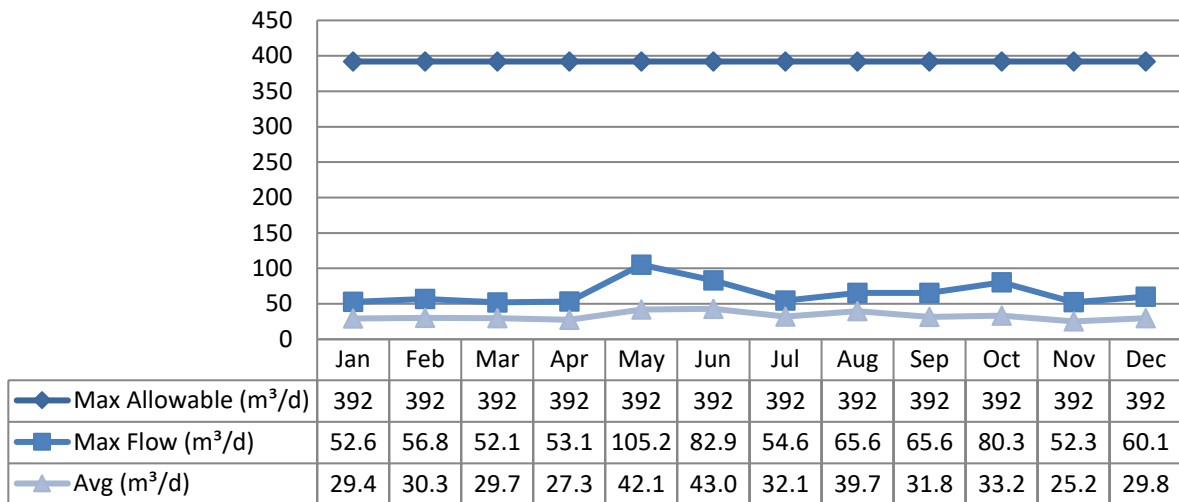

Monthly Rated Flows (L/s)
Max allowable rate – PTTW- Well #2

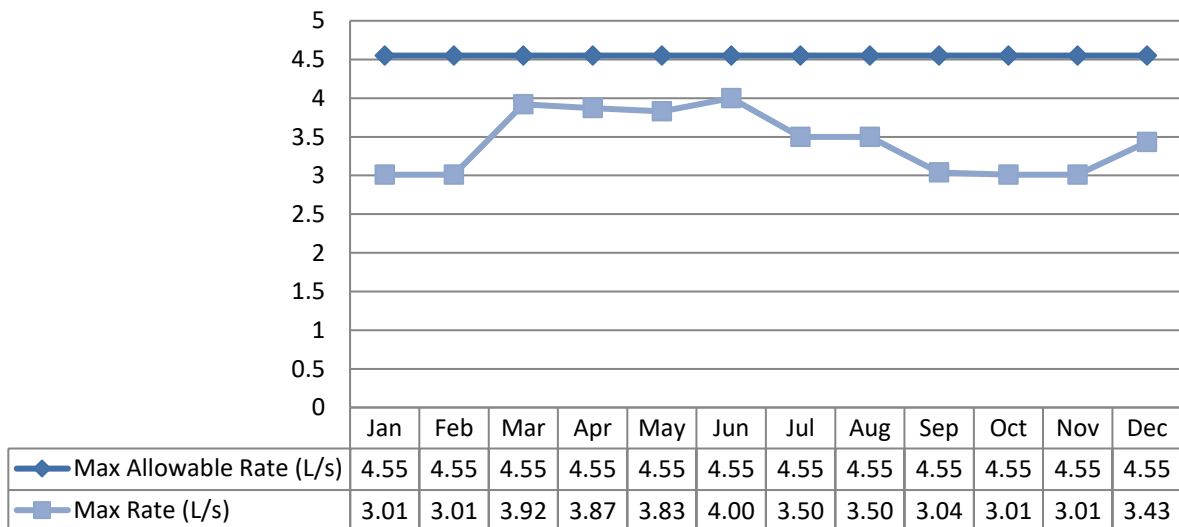


Treated Water Flows

The Treated Water flows are regulated under the Municipal Licence.


Monthly Rated Flows

Rated Capacity - MDWL

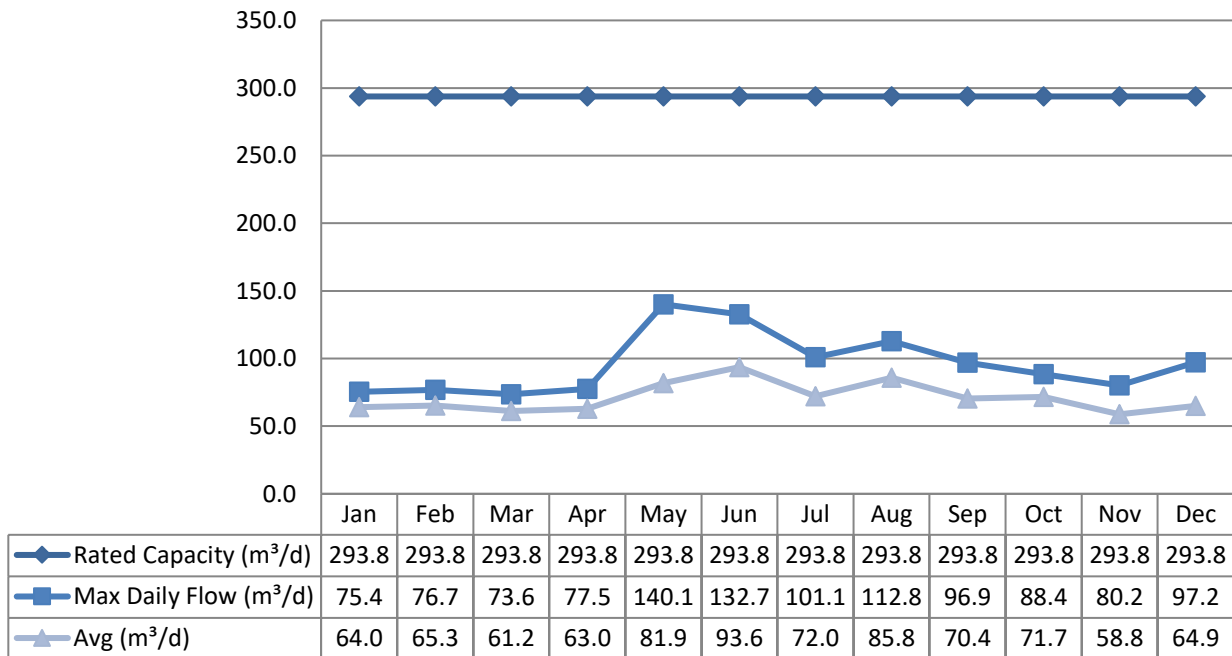

Annual Total Flow Comparison

Total Annual m³

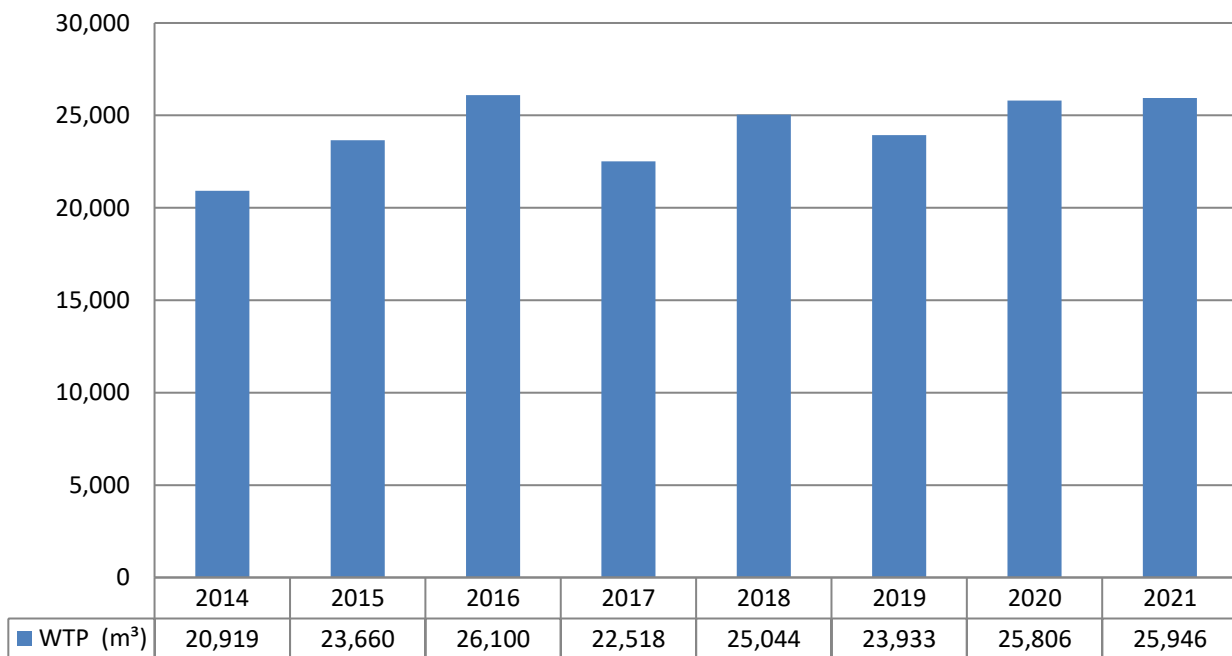

NOTE: 2014 data for March to December as DWS operated by the City until Feb 2014.

Regulatory Sample Results Summary

Microbiological Testing

	No. of Samples Collected	Range of E. Coli Results		Range of Total Coliform Results		No. of Samples Collected	Range of HPC Results	
		Min	Max	Min	Max		Min	Max
Raw Well 1	52	0	1	0	1			
Raw Well 2	52	0	4	0	7			
Treated	52	0	0	0	0	52	0	1
Distribution	156	0	0	0	0	156	0	2

Operational Testing

	No. of Samples Collected	Range of Results	Range of Results
		Min	Max
Turbidity Filter 1 (NTU)	8760	0.00	1.50
Turbidity Filter 2 (NTU)	8760	0.00	1.50
Chlorine	8760	1.46	2.76
Fluoride (If the DWS provides fluoridation)	N/A	N/A	N/A

Note: Record the unit of measure if it is **not** milligrams per litre.

Note: For continuous monitors 8760 is used as the number of samples. Spikes recorded by on-line instrumentation were a result of air bubbles and various maintenance/calibration activities. All spikes are reviewed for compliance with O. Reg.170/03.

Inorganic Parameters

These parameters are tested as a requirement under 170/03. Sodium and Fluoride are required to be tested every 5 years. Nitrate and Nitrite are tested quarterly and the metals are tested annually as required under 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

- MAC = Maximum Allowable Concentration as per O. Reg.169/03
- MDL = Method Detection Limit

Treated Water	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance	Exceedance
				MAC	1/2 MAC
Antimony: Sb (ug/L) - TW	2021/09/07	<MDL 0.9	6.0	No	No
Arsenic: As (ug/L) - TW	2021/09/07	<MDL 0.2	10.0	No	No
Barium: Ba (ug/L) - TW	2021/09/07	47.0	1000.0	No	No
Boron: B (ug/L) - TW	2021/09/07	46.0	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2021/09/07	0.009	5.0	No	No

Treated Water	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance	Exceedance
				MAC	1/2 MAC
Chromium: Cr (ug/L) - TW	2021/09/07	0.62	50.0	No	No
Mercury: Hg (ug/L) - TW	2021/09/07	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L) - TW	2021/09/07	0.27	50.0	No	No
Uranium: U (ug/L) - TW	2021/09/07	0.215	20.0	No	No
Additional Inorganics					
Fluoride (mg/L) - TW	2018/12/03	0.21	1.5	No	No
Nitrite (mg/L) - TW	2021/01/04	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2021/04/12	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2021/07/05	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2021/10/04	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2021/01/04	0.098	10.0	No	No
Nitrate (mg/L) - TW	2021/04/12	0.114	10.0	No	No
Nitrate (mg/L) - TW	2021/07/05	0.221	10.0	No	No
Nitrate (mg/L) - TW	2021/10/04	0.175	10.0	No	No
Sodium: Na (mg/L) - TW	2018/12/07	18.1	20*	No	Yes

*There is no "MAC" for Sodium. The aesthetic objective for sodium in drinking water is 200 mg/L. The local Medical Officer of Health should be notified mg/L when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

Schedule 15 Sampling:

The Schedule 15 Sampling is required under O. Reg.170/03. This system is under reduced sampling. No plumbing samples were collected.

Distribution System	Number of Sampling Points	Number of Samples	Range of Results	Range of Results	MAC (ug/L)	Number of Exceedances
			Minimum	Maximum		
Alkalinity (mg/L)	2	2	208	223	N/A	N/A
pH	2	2	7.50	8.35	N/A	N/A
Lead (ug/l)	N/A	N/A	N/A	N/A	N/A	N/A

Organic Parameters

These parameters are tested annually as a requirement under O. Reg.170/03. In the event any of the parameters exceed half of the maximum allowable concentration the

parameter is required to be sampled quarterly.

Treated Water	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance	Exceedance
				MAC	1/2 MAC
Alachlor (ug/L) - TW	2021/09/07	<MDL 0.02	5.0	No	No
Atrazine + N-dealkylated metabolites (ug/L) - TW	2021/09/07	<MDL 0.01	5.0	No	No
Azinphos-methyl (ug/L) - TW	2021/09/07	<MDL 0.05	20.0	No	No
Benzene (ug/L) - TW	2021/09/07	<MDL 0.32	1.0	No	No
Benzo(a)pyrene (ug/L) - TW	2021/09/07	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2021/09/07	<MDL 0.33	5.0	No	No
Carbaryl (ug/L) - TW	2021/09/07	<MDL 0.05	90.0	No	No
Carbofuran (ug/L) - TW	2021/09/07	<MDL 0.01	90.0	No	No
Carbon Tetrachloride (ug/L) - TW	2021/09/07	<MDL 0.17	2.0	No	No
Chlorpyrifos (ug/L) - TW	2021/09/07	<MDL 0.02	90.0	No	No
Diazinon (ug/L) - TW	2021/09/07	<MDL 0.02	20.0	No	No
Dicamba (ug/L) - TW	2021/09/07	<MDL 0.2	120.0	No	No
1,2-Dichlorobenzene (ug/L) - TW	2021/09/07	<MDL 0.41	200.0	No	No
1,4-Dichlorobenzene (ug/L) - TW	2021/09/07	<MDL 0.36	5.0	No	No
1,2-Dichloroethane (ug/L) - TW	2021/09/07	<MDL 0.35	5.0	No	No
1,1-Dichloroethylene (ug/L) - TW	2021/09/07	<MDL 0.33	14.0	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2021/09/07	<MDL 0.35	50.0	No	No
2,4-Dichlorophenol (ug/L) - TW	2021/09/07	<MDL 0.15	900.0	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2021/09/07	<MDL 0.19	100.0	No	No
Diclofop-methyl (ug/L) - TW	2021/09/07	<MDL 0.4	9.0	No	No
Dimethoate (ug/L) - TW	2021/09/07	<MDL 0.06	20.0	No	No
Diquat (ug/L) - TW	2021/09/07	<MDL 1.0	70.0	No	No
Diuron (ug/L) - TW	2021/09/07	<MDL 0.03	150.0	No	No
Glyphosate (ug/L) - TW	2021/09/07	<MDL 1.0	280.0	No	No
Malathion (ug/L) - TW	2021/09/07	<MDL 0.02	190.0	No	No
Metolachlor (ug/L) - TW	2021/09/07	<MDL 0.01	50.0	No	No
Metribuzin (ug/L) - TW	2021/09/07	<MDL 0.02	80.0	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2021/09/07	<MDL 0.3	80.0	No	No
Paraquat (ug/L) - TW	2021/09/07	<MDL 1.0	10.0	No	No

Treated Water	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedance	Exceedance
				MAC	1/2 MAC
PCB (ug/L) - TW	2021/09/07	<MDL 0.04	3.0	No	No
Pentachlorophenol (ug/L) - TW	2021/09/07	<MDL 0.15	60.0	No	No
Phorate (ug/L) - TW	2021/09/07	<MDL 0.01	2.0	No	No
Picloram (ug/L) - TW	2021/09/07	<MDL 1.0	190.0	No	No
Prometryne (ug/L) - TW	2021/09/07	<MDL 0.03	1.0	No	No
Simazine (ug/L) - TW	2021/09/07	<MDL 0.01	10.0	No	No
Terbufos (ug/L) - TW	2021/09/07	<MDL 0.01	1.0	No	No
Tetrachloroethylene (ug/L) - TW	2021/09/07	<MDL 0.35	10.0	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2021/09/07	<MDL 0.2	100.0	No	No
Triallate (ug/L) - TW	2021/09/07	<MDL 0.01	230.0	No	No
Trichloroethylene (ug/L) - TW	2021/09/07	<MDL 0.44	5.0	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2021/09/07	<MDL 0.25	5.0	No	No
2-methyl-4-chlorophenoxyacetic acid (MCPA) (ug/L) - TW	2021/09/07	<MDL 0.12	100.0	No	No
Trifluralin (ug/L) - TW	2021/09/07	<MDL 0.02	45.0	No	No
Vinyl Chloride (ug/L) - TW	2021/09/07	<MDL 0.17	1.0	No	No
Distribution Water					
Trihalomethane: Total (ug/L) Annual Average - DW	2021	49.5	100	No	No
HAA Total (ug/L) Annual Average - DW	2021	8.6	80	No	No

MAC = Maximum Allowable Concentration as per O. Reg.169/03

MDL = Method Detection Limit

Additional Legislated Samples



There was no additional sampling required.

Major Maintenance Summary incurred to install, repair or replace required equipment

WO #	Description
2178286	Replaced Backup Generator Battery
1835930	Repaired Pumps MP-03 and MP-04
2133985	Repaired Leaking Pressure Relief Valve on Chlorine Pump
2317329	Replaced Flex Line on Highlift Pump Pressure Relief Valve
2092255	Replace Pressure Gauge on Well 2

Appendix A

WTRS Data Submission Confirmation



Ministry of the Environment,
Conservation and Parks

| [WT DATA](#) | [USER PROFILE](#) | [CONTACT US](#) | [HELP](#) | [HOME](#) | [LOGOUT](#) |

Location: [WTRS](#) / [WT DATA](#) / [Input WT Record](#) WTRS-WT-008

Water Taking Data submitted successfully.

Confirmation:


Thank you for submitting your water taking data online.

Permit Number: 2180-B4CKK3
Permit Holder: THE CORPORATION OF THE CITY OF KAWARTHA LAKES.
Received on: Jan 28, 2022 3:24 PM

This confirmation indicates that your data has been received by the Ministry, but should not be construed as acceptance of this data if it differs from that specified on the Permit Number, assigned to the Permit Holder stated above.

[Print Confirmation](#) [Return to Main Page](#)

CITY OF KAWARTHA LAKES | 2022/01/28
version: v4.5.0.21 (build#: 22)
Last modified: 2018/09/18

 This site maintained by
the Government of Ontario ©2022 [Queen's Printer for Ontario](#)