


DRAWING "B"

INSTALLATION PLAN VIEW

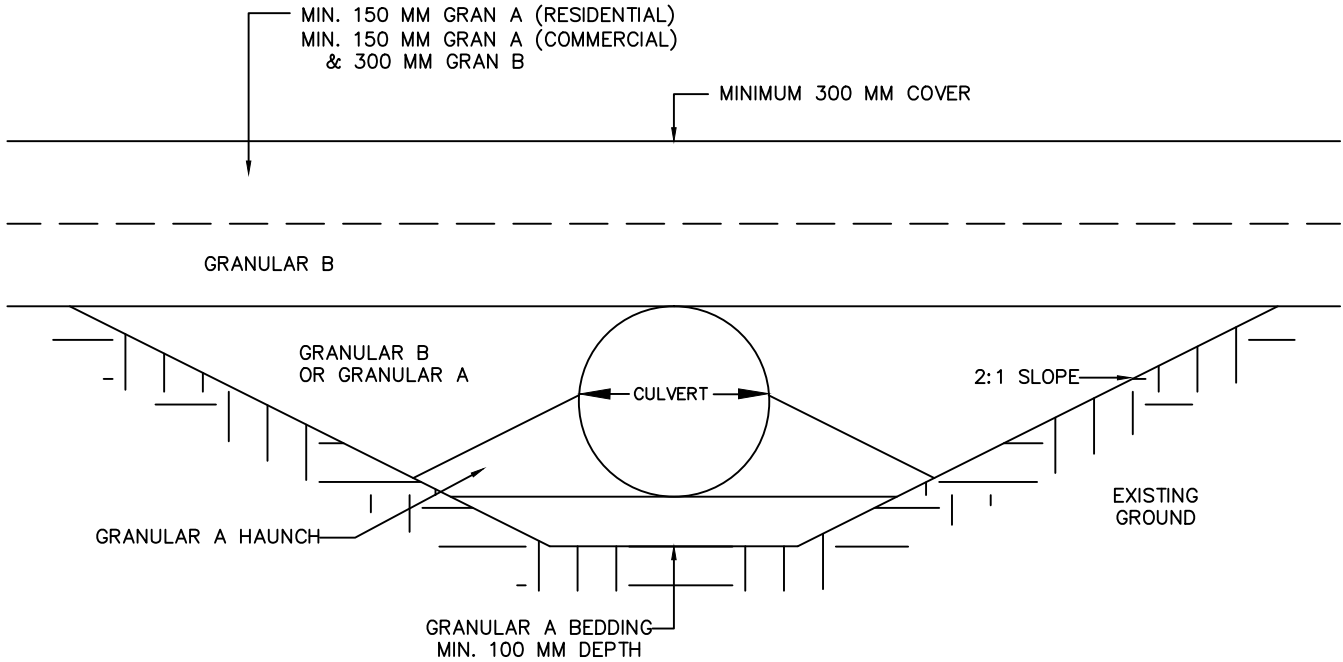

NOTES

1. PIPE CULVERT
MINIMUM 400 MM DIAMETER CSP
MINIMUM 375 MM DIAMETER CPP (BOSS 2000 OR APPROVED EQUIVALENT)
2. COMPACT BEDDING, HAUNCH, AND BACKFILL MATERIAL TO 98% SPD.
3. EXISTING SUBGRADE MATERIAL MUST BE CAPABLE OF SUPPORTING A MINIMUM OF 150 KPA. (THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THE SUB BASE MATERIAL IS CAPABLE TO SUPPORTING THE CULVERT WITHOUT SETTLEMENT).
4. ALL GRANULAR MATERIALS AS PER OPSS 1010.

ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE NOTED

DATE: 2011 09	CKL STANDARD DETAIL RURAL ENTRANCE STANDARD	NOT TO SCALE
DRAWN: IB		REVISION No. 1
CHECKED: --		DATE: 2011 09
APPROVED: --		CKL-412 DRAWING B