

North Indicator



Smoke Alarm

Strobe Light Combination

(r) Fire Door

EP Electrical Panel

K Key Lock Box

(**⊙**) Fire Hydrant

♦ Smoke Detector

Heat Detector

●sH Sprinkler Head

FAMP Fire Alarm Annunciator Panel

Fire Route

Assembly Area

© Emergency Exit

Tire Department Access

FACP Fire Alarm Control Panel

Emergency Light

✓ Manual Pull Station


Portable Fire Extinguisher

Emergency Exit Sign


Н Mini-Horn

Handicap Lit

Mini-Horn and Strobe Light Combination

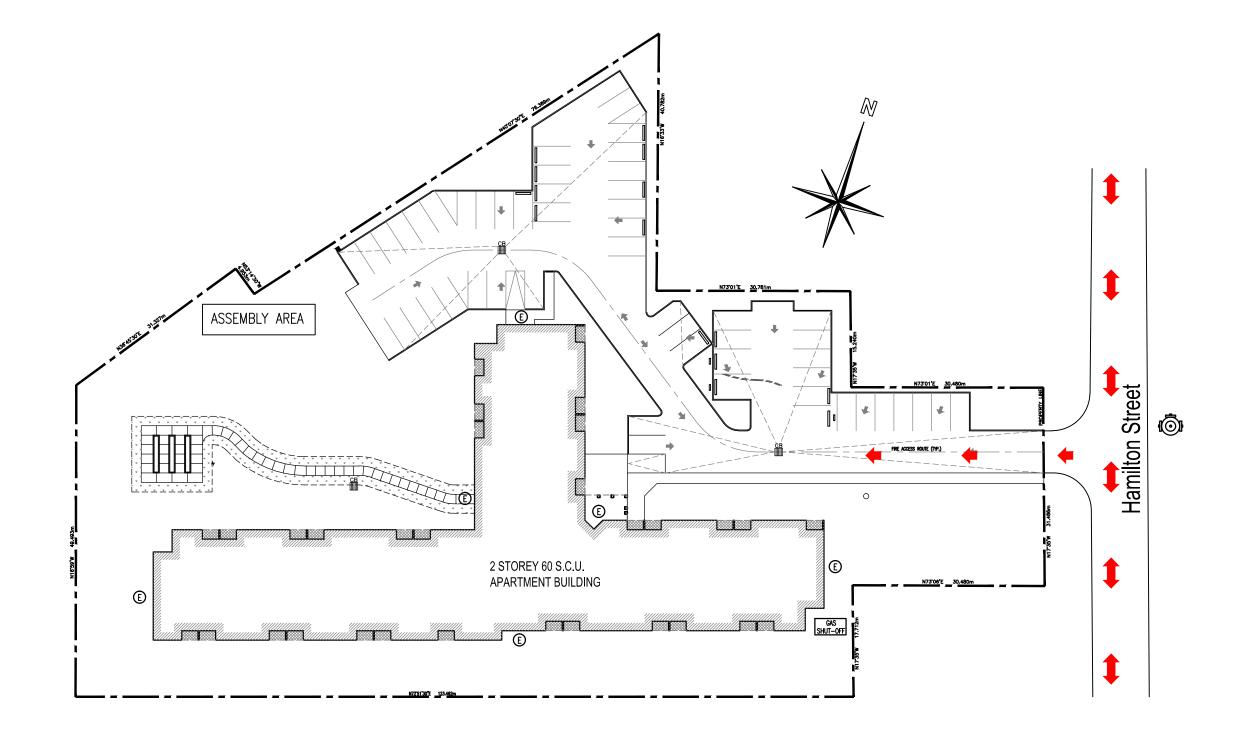


Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On.







North Indicator



Smoke Alarm

Strobe Light Combination

(r) Fire Door

EP Electrical Panel

K Key Lock Box

Fire Hydrant

◆ Smoke Detector

Heat Detector

●sн Sprinkler Head

FAAP Fire Alarm
Annunciator Panel

Fire Route

ASSEMBLY AREA Assembly Area

© Emergency Exit

Tire Department Access

FACP Fire Alarm Control Panel

Emergency Light

✓ Manual Pull Station


Portable Fire Extinguisher

Emergency Exit Sign

н Mini-Horn

■ Handicap Lif

Mini-Horn and Strobe Light Combination

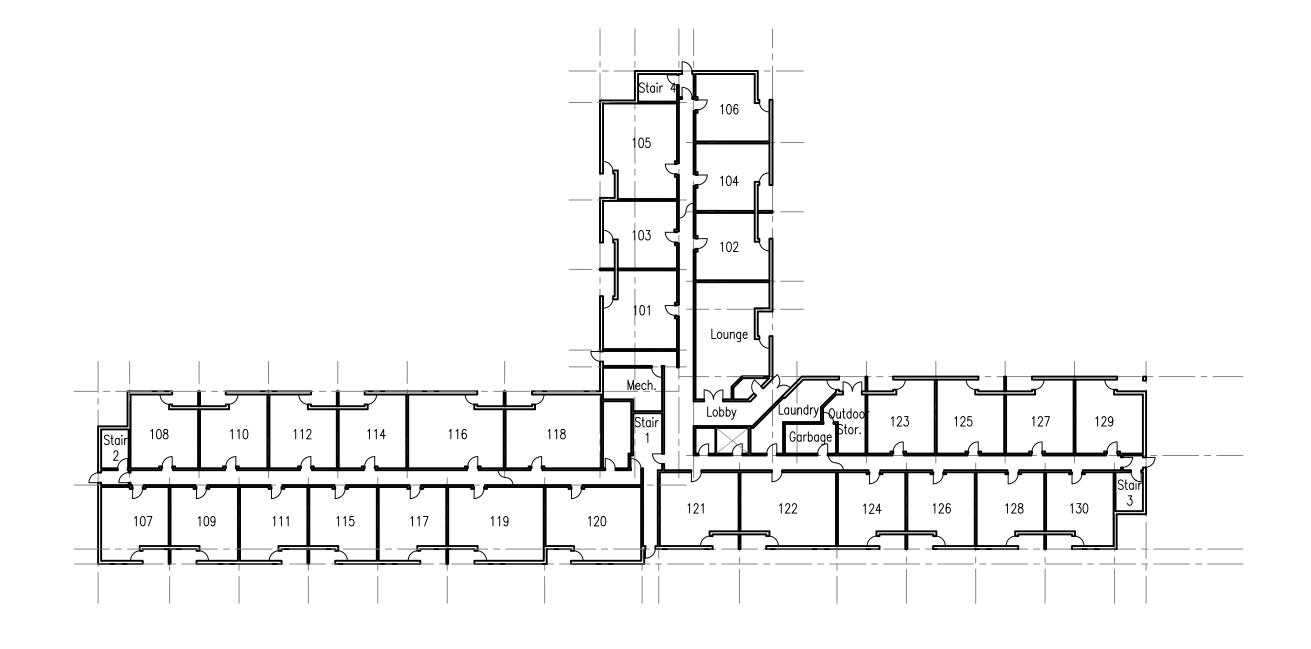


Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On. Main Floor Plan FP-2 $\frac{1}{32}$ " = 1' - 0"





North Indicator



Smoke Alarm

Strobe Light Combination

Fire Door

EP Electrical Panel

K Key Lock Box

Fire Hydrant

♦ Smoke Detector

Heat Detector

●sн Sprinkler Head

FAAP Fire Alarm
Annunciator Panel

Fire Route

Assembly Area Assembly Area

© Emergency Exit

© Fire Department Access

FACP Fire Alarm Control Panel

Emergency Light

✓ Manual Pull Station


Portable Fire Extinguisher

Emergency Exit Sign

H Mini-Horn

Handicap Lit

Mini-Horn and Strobe Light Combination

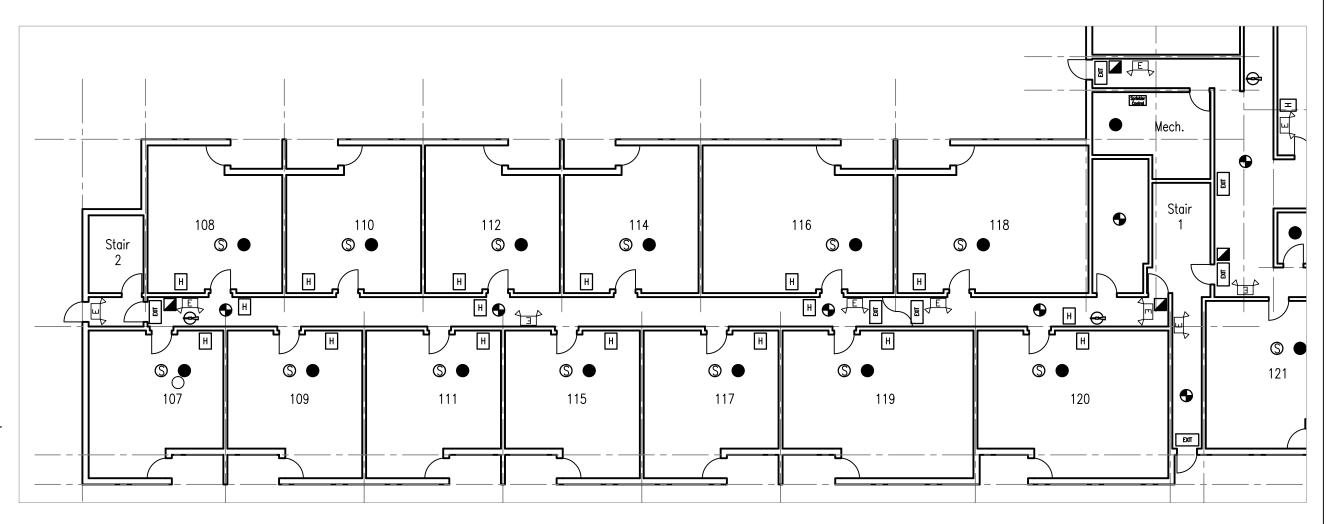

Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On. Main Floor Partial Plan FP-3 $\frac{1}{16}$ " = 1' - 0"





North Indicator

---- Property Line

Smoke Alarm

Strobe Light Combination

Fire Door

Electrical Panel

K Key Lock Box

Fire Hydrant

Smoke Detector

Heat Detector

●sH Sprinkler Head

FAMP Fire Alarm Annunciator Panel

Fire Route

ASSEMBLY AREA Assembly Area

© Emergency Exit

Fire Department Access

Face Fire Alarm Control Panel

Emergency Light

✓ Manual Pull Station


Ortable Fire Extinguisher

Emergency Exit Sign

Н Mini-Horn

Handicap Lit

Mini-Horn and Strobe Light Combination

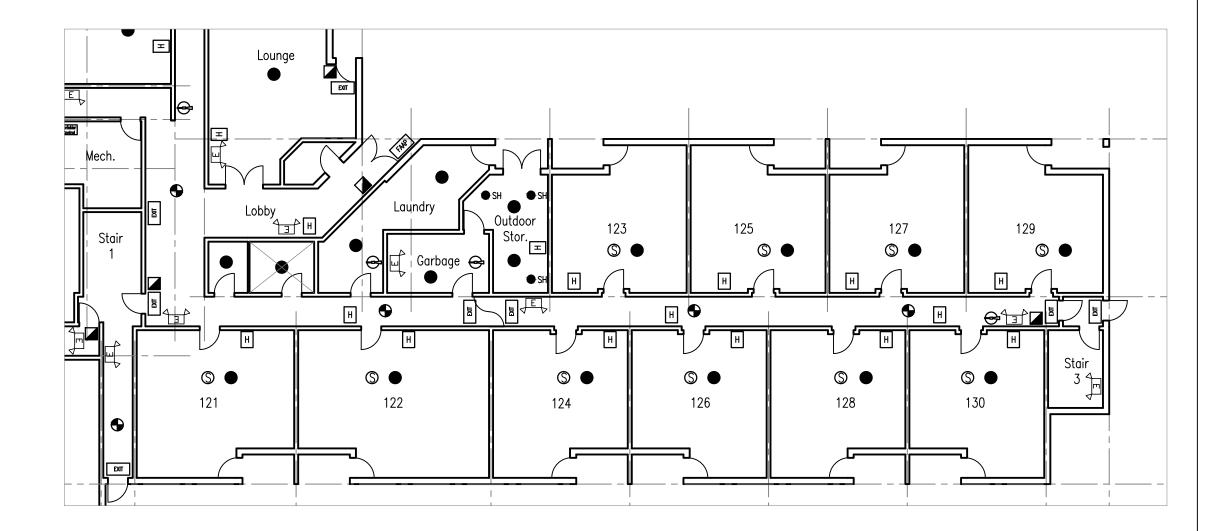

Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On. Main Floor Partial Plan FP-4 $\frac{1}{16}$ " = 1' - 0"



1

North Indicator

---- Property Line

Smoke Alarm

Strobe Light Combination

Fire Door

EP Electrical Panel

K Key Lock Box

Fire Hydrant

Smoke Detector

Heat Detector

●sH Sprinkler Head

FAAP Fire Alarm Annunciator Panel

Fire Route

ASSEMBLY AREA Assembly Area

Emergency Exit

Fire Department Access

FACP Fire Alarm Control Panel

Emergency Light

✓ Manual Pull Station


Portable Fire Extinguisher

Emergency Exit Sign

Н Mini-Horn

Handicap Lif

Mini-Horn and Strobe Light Combination

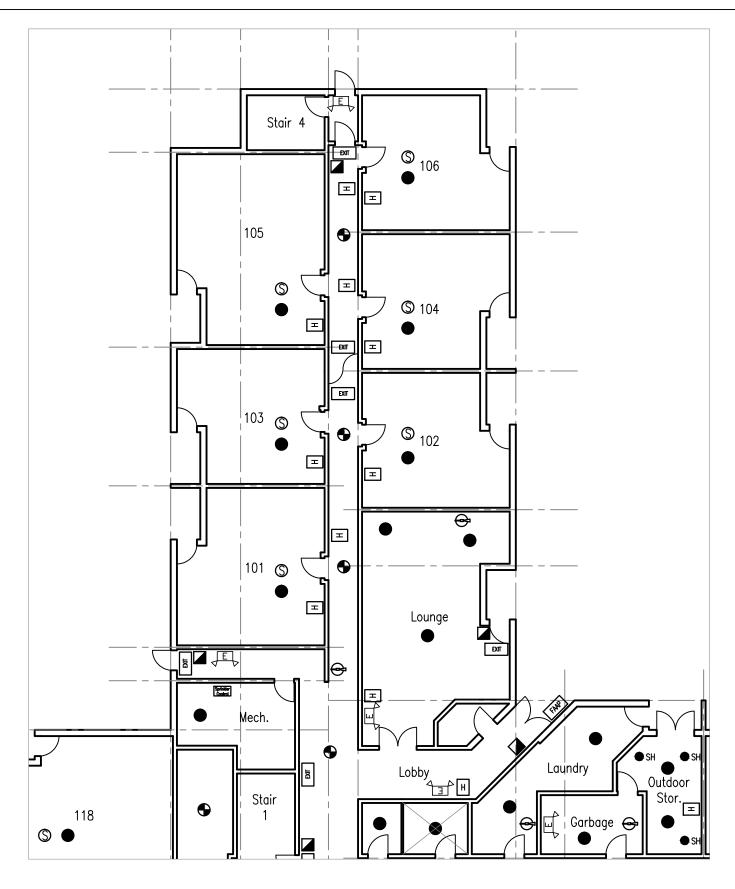

Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On. Main Floor Partial Plan FP-5 $\frac{1}{16}$ " = 1' - 0"





North Indicator

---- Property Line


Smoke Alarm

 $\begin{tabular}{ll} \hline s-$L & Strobe Light Combination \\ \hline \end{tabular}$



EP Electrical Panel

K Key Lock Box



♠ Smoke Detector

Heat Detector

●sH Sprinkler Head

FAAP Fire Alarm
Annunciator Panel

Fire Route

Assembly Area Assembly Area

© Emergency Exit

© Fire Department Access

FACP Fire Alarm Control Panel

Emergency Light

Manual Pull Station


Portable Fire Extinguisher

Emergency Exit Sign

H Mini-Horn

Handicap Lif

Mini-Horn and Strobe Light Combination

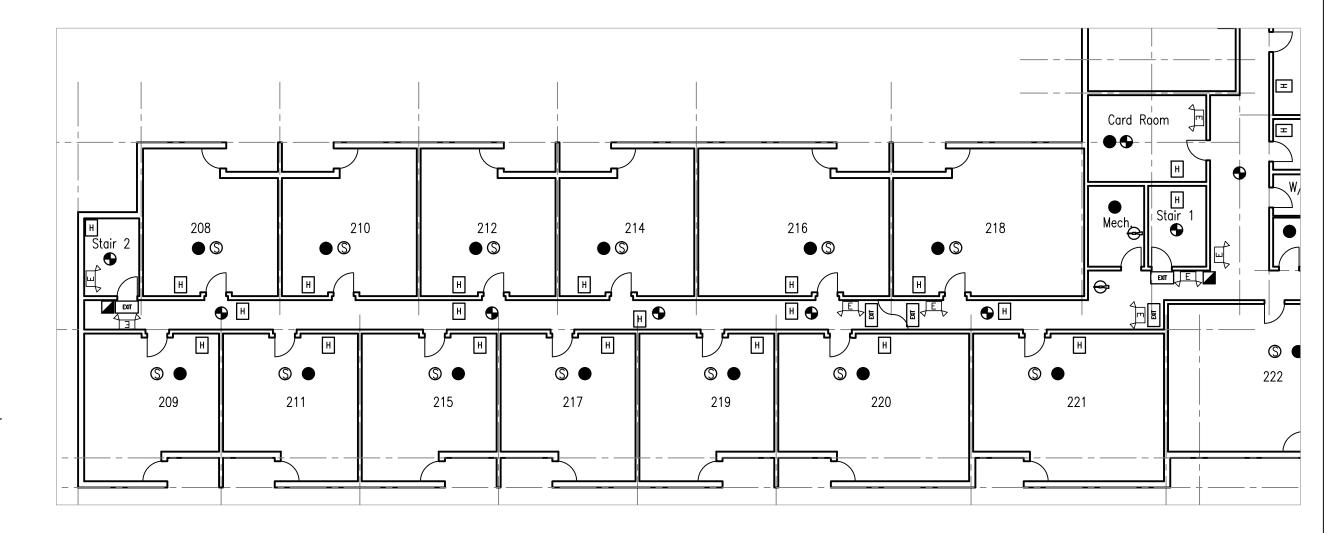

Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On. Second Floor Partial Plan FP-6 $\frac{1}{16}$ " = 1' - 0"





North Indicator



Smoke Alarm

Strobe Light Combination



EP Electrical Panel



Fire Hydrant

♠ Smoke Detector

Heat Detector

●sH Sprinkler Head

FAAP Fire Alarm
Annunciator Panel

Fire Route

ASSEMBLY AREA Assembly Area

© Emergency Exit

Fire Department Access

Face Fire Alarm Control Panel

Emergency Light

✓ Manual Pull Station


Portable Fire Extinguisher

Emergency Exit Sign

Н Mini-Horn

Handicap Lit

Mini—Horn and Strobe Light Combination

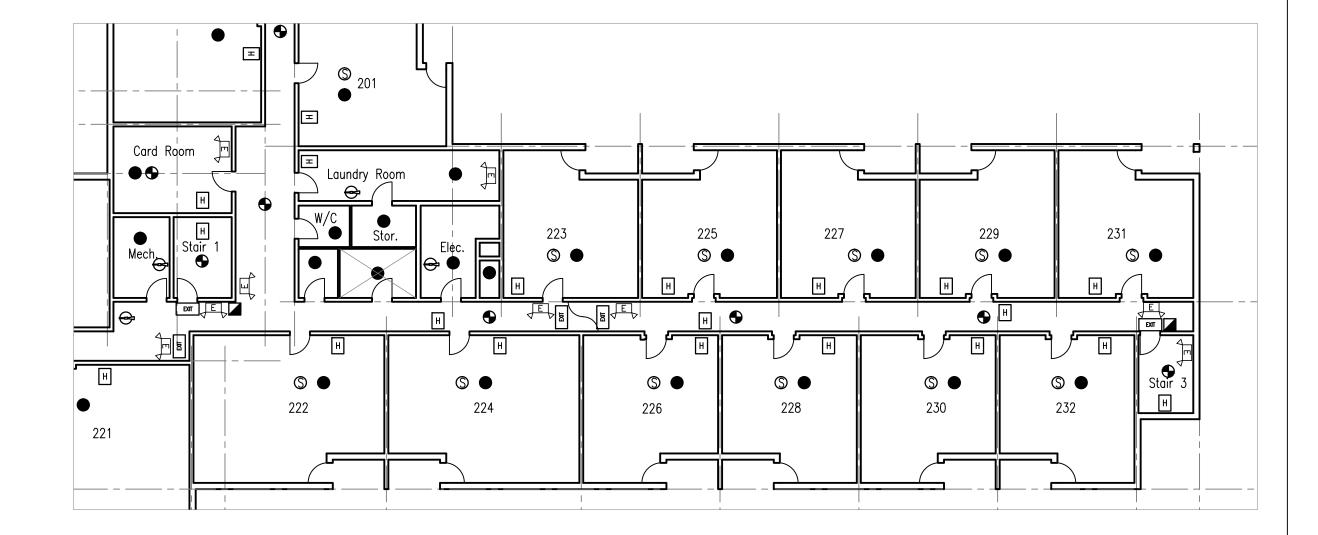

Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On. Second Floor Partial Plan FP-7 $\frac{1}{16}$ " = 1' - 0"





North Indicator

---- Property Line

Smoke Alarm

Strobe Light Combination

 \bigcap Fire Door

EP Electrical Panel

K Key Lock Box

Fire Hydrant

Smoke Detector

Heat Detector

●sH Sprinkler Head

FAAP Fire Alarm Annunciator Panel

Fire Route

ASSEMBLY AREA Assembly Area

© Emergency Exit

Fire Department Access

FACP Fire Alarm Control Panel

Emergency Light

✓ Manual Pull Station


ner Portable Fire Extinguisher

Emergency Exit Sign

Н Mini-Horn

Handicap Lif

Mini-Horn and Strobe Light Combination

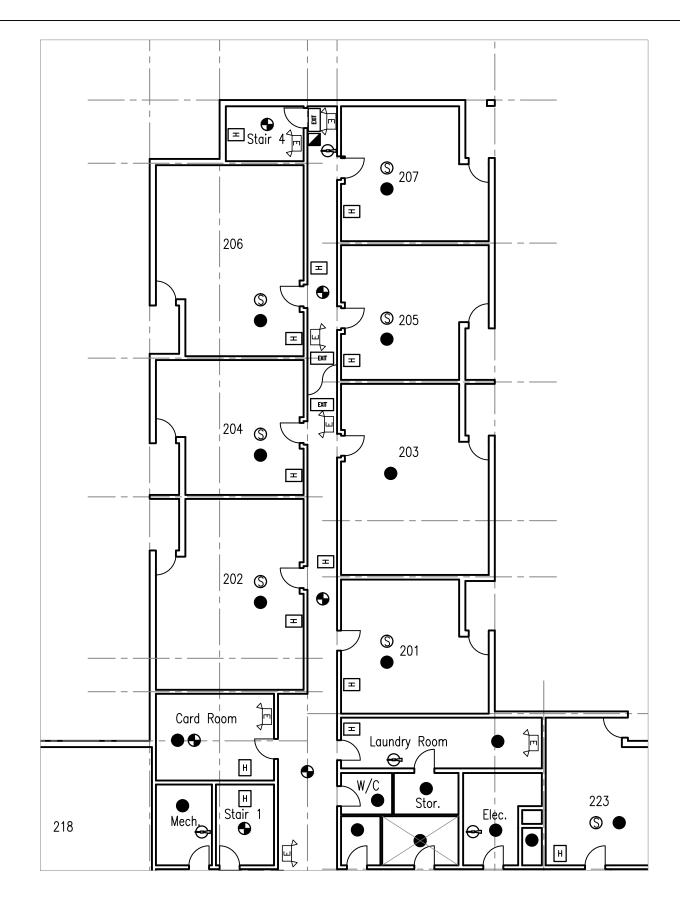

Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On. Second Floor Partial Plan FP-8 $\frac{1}{16}$ " = 1' - 0"



North Indicator

----- Property Line

Smoke Alarm

Strobe Light Combination

(厂) Fire Door

Electrical Panel

K Key Lock Box

🔊 Fire Hydrant

Smoke Detector

Heat Detector

●sH Sprinkler Head

FMP Fire Alarm
Annunciator Panel

Fire Route

ASSEMBLY AREA Assembly Area

Emergency Exit

(Fire Department Access)

FACP Fire Alarm Control Panel

Emergency Light

Manual Pull Station


Portable Fire Extinguisher

™ Emergency Exit Sign


Н Mini-Horr


■ Handicap Lift

Mini—Horn and Strobe
Light Combination

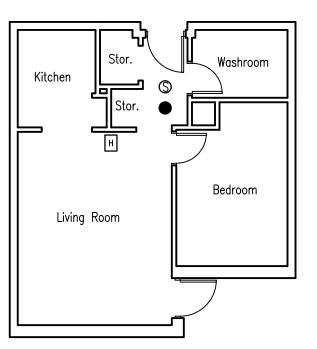


1 Typical Suite "A" 1/8" = 1'-0"

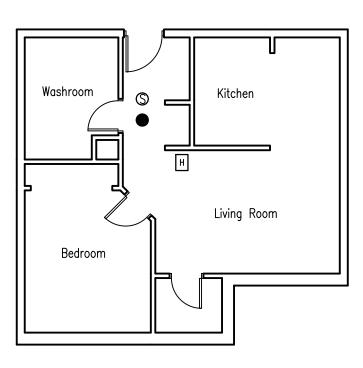

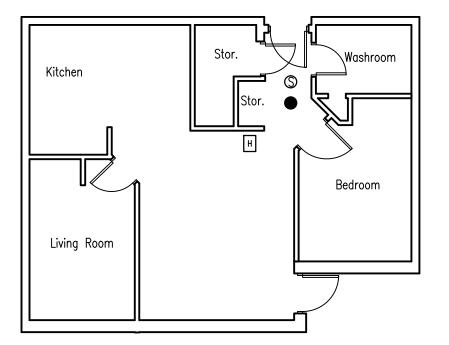

2 Typical Suite "B"

1/8" = 1'-0"

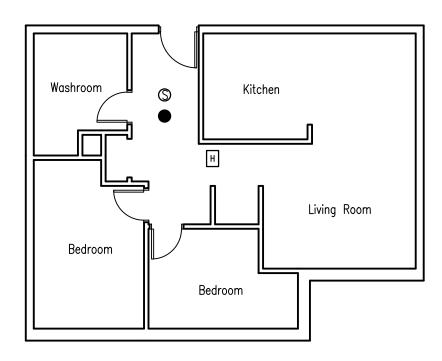

Typical Suite "D"


1/8" = 1'-0"

Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On. Typical Suite Plan FP-9 $\frac{1}{8}$ " = 1' - 0"





North Indicator



Smoke Alarm

Strobe Light Combination



K Key Lock Box



Smoke Detector

● Heat Detector

●sH Sprinkler Head

FAMP Fire Alarm Annunciator Panel

Fire Route

ASSEMBLY AREA Assembly Area

E Emergency Exit

Fire Department Access

FACP Fire Alarm Control Panel

Emergency Light

Manual Pull Station


Portable Fire Extinguisher

Emergency Exit Sign


н Mini-Horn

■ Handicap Lift


Mini-Horn and Strobe Light Combination

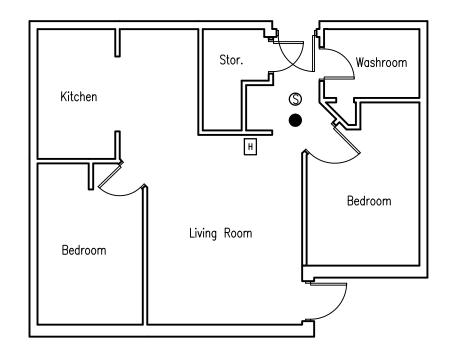



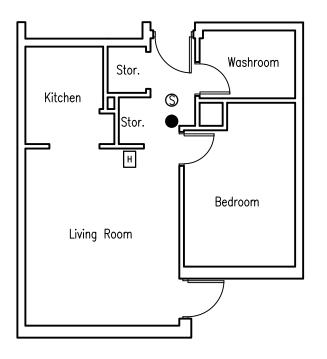



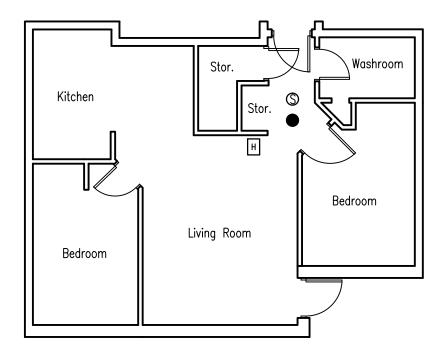

3 Typical Suite "Bx"

1/8" = 1'-0"

Hamilton Place Apartments 60 Units - 2 Storey 19 Hamilton St. Lindsay, On. Typical Suite Plan FP-10 $\frac{1}{8}$ " = 1' - 0"

