

Woodfield Drinking Water System 2025 Annual Water Report

Drinking Water System Number: 220012251

Drinking Water System Operating Authorities: City of Kawartha Lakes and Ontario
Clean Water Agency

Drinking Water System Category: Small Municipal Residential

Reporting Period: January 1st – December 31st, 2025



Table of Contents

2025 Annual Drinking Water System Summary Report.....	3
General Information	3
Compliance Summary	3
Drinking Water System Description	4
Source Water	4
Water Treatment Facility	4
Distribution System	4
Summary of Non-Compliance.....	5
Adverse Water Quality Incidents	5
Non-Compliance.....	5
Non-Compliance Identified in a Ministry Inspection	5
Flows	6
Raw Water Flows	6
Treated Water Flows	9
Regulatory Sample Results Summary	10
Microbiological Testing	10
Operational Testing	10
Inorganic Parameters	10
Schedule 15 Sampling (Lead).....	11
Organic Parameters.....	12
Additional Legislated Samples	14
Minor Maintenance.....	14
Major Maintenance Expense (above \$10,000)	14
APPENDIX A	15
WTR Submission Confirmation	15

2025 Annual Drinking Water System Summary Report

General Information

The City of Kawartha Lakes prepares a report summarizing system operation and water quality for every municipal drinking water system annually. This report has been prepared to satisfy the annual reporting requirements in O. Reg. 170/03 Section 11 and Schedule 22. The annual reports will be available to residents at the City of Kawartha Lakes Public Works Administration Office by appointment and the [City's website](#). Notification that the reports are available free of charge will be made on the City of Kawartha Lakes website. The City of Kawartha Lakes Public Works Administration Office is located at 322 Kent Street West in Lindsay, Ontario.

This system does not serve more than 10,000 residences.

- Drinking Water System Number:** 220012251
- Drinking Water System Name:** Woodfield Drinking Water System
- Drinking Water System Owner:** City of Kawartha Lakes
- Drinking Water System Category:** Small Municipal Residential
- Reporting Period:** January 1, 2025 – December 31, 2025

Compliance Summary

Table 1. Drinking Water Compliance Summary

	Number of Events	Date (yyyy/mm/dd)	Details
Ministry (MECP) Inspections	1	2025 06 19	Announced Detailed Drinking Water Inspection – Final Inspection Rate of 96.41%
Adverse Water Quality Incidents (AWQIs)	1	2025 03 31	Loss of pressure due to generator failure
Non-Compliances	1	2024 11 25-27	Issue with continuous monitoring equipment not in compliance with O. reg. 170/03
Boil Water Advisories	1	2025 03 31	Loss of pressure due to generator failure

	Number of Events	Date (yyyy/mm/dd)	Details
Health and Safety	0		

Drinking Water System Description

The Woodfield drinking water system is a small municipal residential drinking water system serving the Woodfield subdivision located in Bethany, Ontario within the City of Kawartha Lakes. The drinking water system is classified as Class I Water Treatment and Class I Water Distribution subsystems in accordance with O. Reg. 128/04.

Source Water

The water supply for the system is obtained from two groundwater wells, Well #1 and Well #2. The wells are designated as non-GUDI, meaning they are not considered groundwater under the direct influence of surface water.

Water Treatment Facility

The Woodfield water treatment facility includes a sodium hypochlorite feed system for primary and secondary disinfection, and a sodium silicate system for iron sequestration. Chlorine contact is provided through a 400 mm diameter, 25 m serpentine pipe installed adjacent to the pumphouse.

A diesel generator is located onsite to provide standby power to the water treatment facility in the event of a power failure.

Distribution System

The distribution system consists of approximately 0.86 kilometres of PVC watermain and is not rated for fire protection. The system does not include treated water storage facilities, chlorine boosting stations, secondary disinfection processes, or pressure boosting capabilities within the control of the distribution system.

Table 2. Treatment Chemicals Used

Chemical Name	Use	Supplier
Sodium Hypochlorite	Disinfection	Jutzi Water Technologies
Sodium Silicate	Iron Sequestering	Jutzi Water Technologies

Summary of Non-Compliance

Table 3. Adverse Water Quality Incidents

Adverse Water Quality Incidents

Date	AWQI #	Location	Problem	Details	Legislation	Corrective Action Taken
2025 03 31	167681 (253103JS02)	Distribution	Loss of pressure	Loss of pressure due to generator fault during prolonged ice storm.	O. Reg. 170/03	BWA issued March 31, 2025 by MOH. Bacti samples collected. Results returned clear. BWA rescinded April 5, 2025.

Non-Compliance

There were no non-compliances reported during the reporting period.

Non-Compliance Identified in a Ministry Inspection

Table 4. Non-Compliance Identified in a Ministry Inspection

Legislation	Requirement(s) System Failed to Meet	Duration of Failure (Dates)	Corrective Action	Status
O. Reg. 170/03	Continuous monitoring equipment that was being utilized to fulfill O. Reg. 170/03 requirements performing tests for the parameters with at least the minimum frequency	November 25 to 27, 2024	Corrected analyzer on November 27, 2024 during further site investigation. Operators were retrained on SOP – Online Chlorine Analyzer	Completed

Legislation	Requirement(s) System Failed to Meet	Duration of Failure (Dates)	Corrective Action	Status
	and recording data with the prescribed format was not being met.		Verification at the December 18, 2024 meeting. This incident was self-reported to MECP on November 28, 2024.	


Flows

The Woodfield Drinking Water System is operating on average under half the rated capacity. The rated capacity of the system (treated water flows) is 295 m³/day.


Raw Water Flows

The raw water flows are regulated under the Permit to Take Water. Raw flow data for 2025 was submitted to the Ministry of Environment, Conservation and Parks (MECP) electronically under permit #8680-AYSHVM. The confirmation of the data that was submitted is attached in Appendix A. The Permit to Take Water compliance criteria is in litres per minute (L/min) but for the purposes of this report the flow rate is reported in litres per second (L/sec) based on industry standard for flow monitoring recording.

Graph 1. Total Monthly Flows (m³/d) – Well #1 (Max Allowable PTTW)

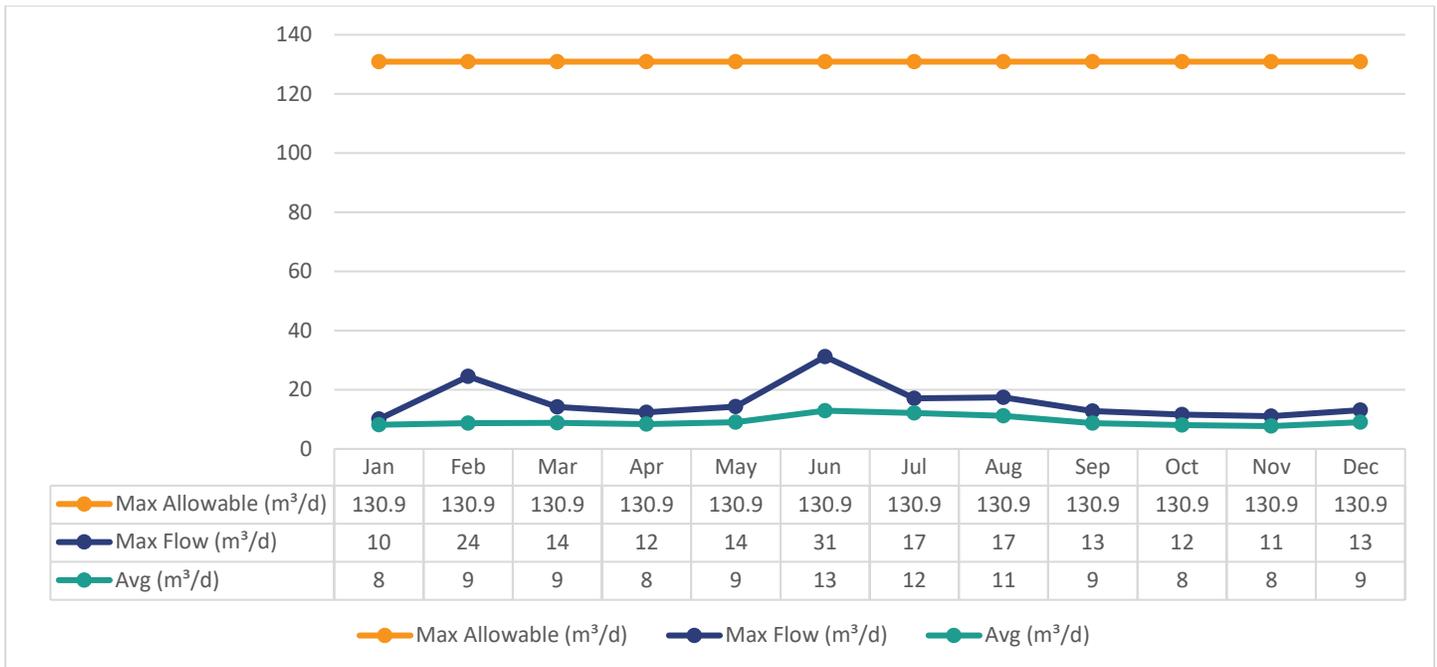


Graph 2. Monthly Rated Flows (L/s) – Well #1 (Max Allowable Rate PTTW)

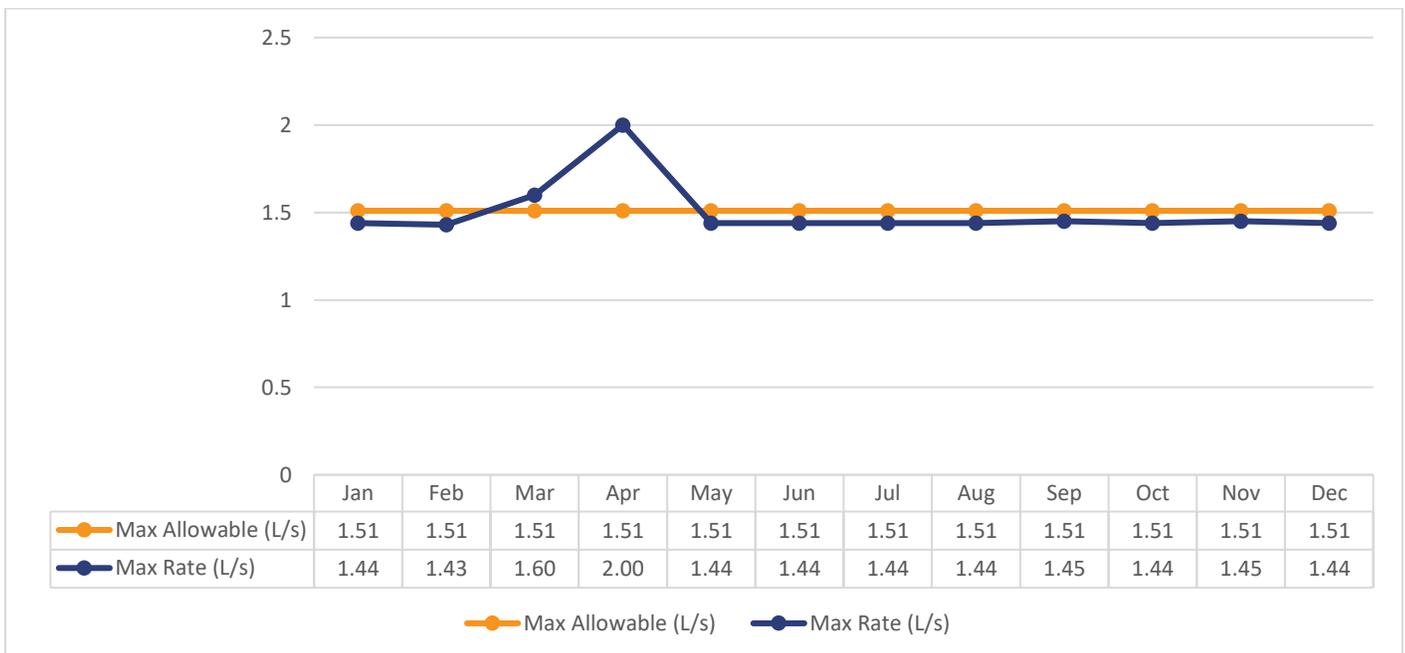


Note: Certain operational circumstances could cause results to be temporarily outside of the allowable rates. In March 2025, the allowable rate was momentarily surpassed as a result of pump start-up upon power being restored as a result of generator failure and did not indicate a true exceedance. In April 2025, the allowable rate was momentarily surpassed as a result of annual calibration of the flow meter and did not indicate a true exceedance. A true exceedance would be documented within this report.

Graph 3. Total Monthly Flows (m³/d) – Well #2 (Max Allowable PTTW)

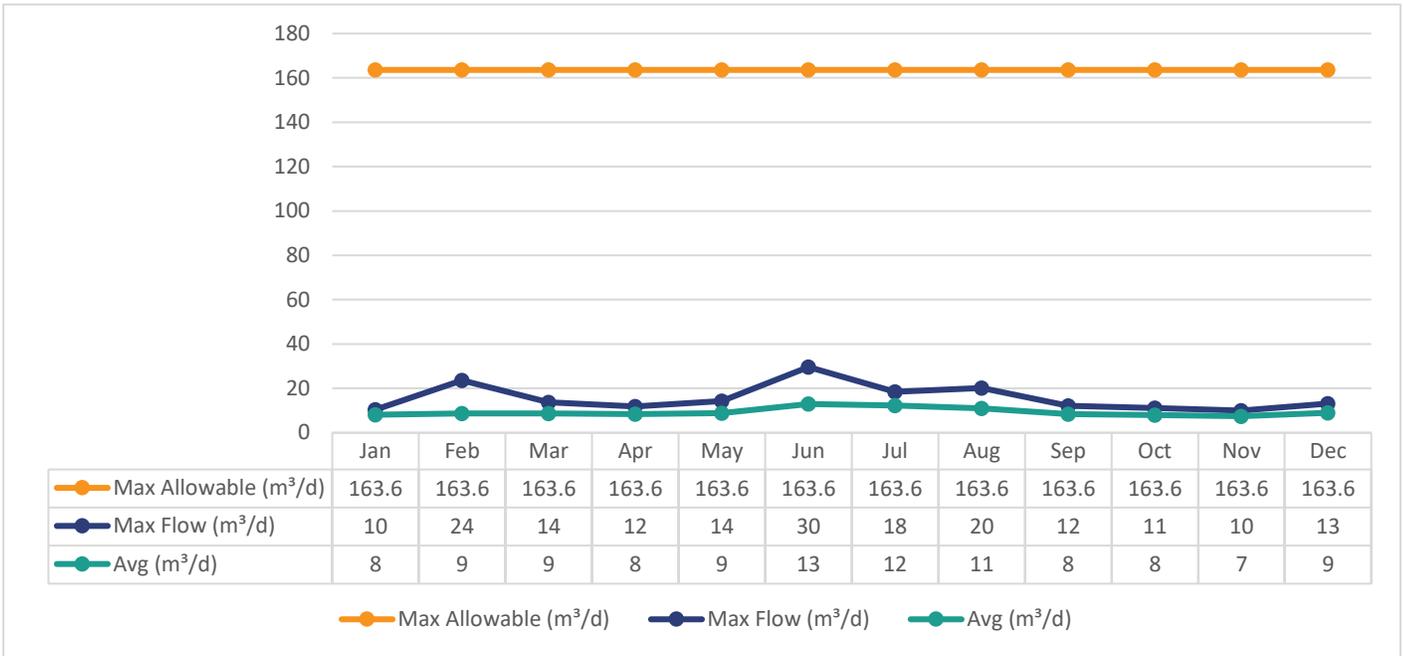


Graph 4. Monthly Rated Flows (L/s) – Well #2 (Max Allowable Rate PTTW)

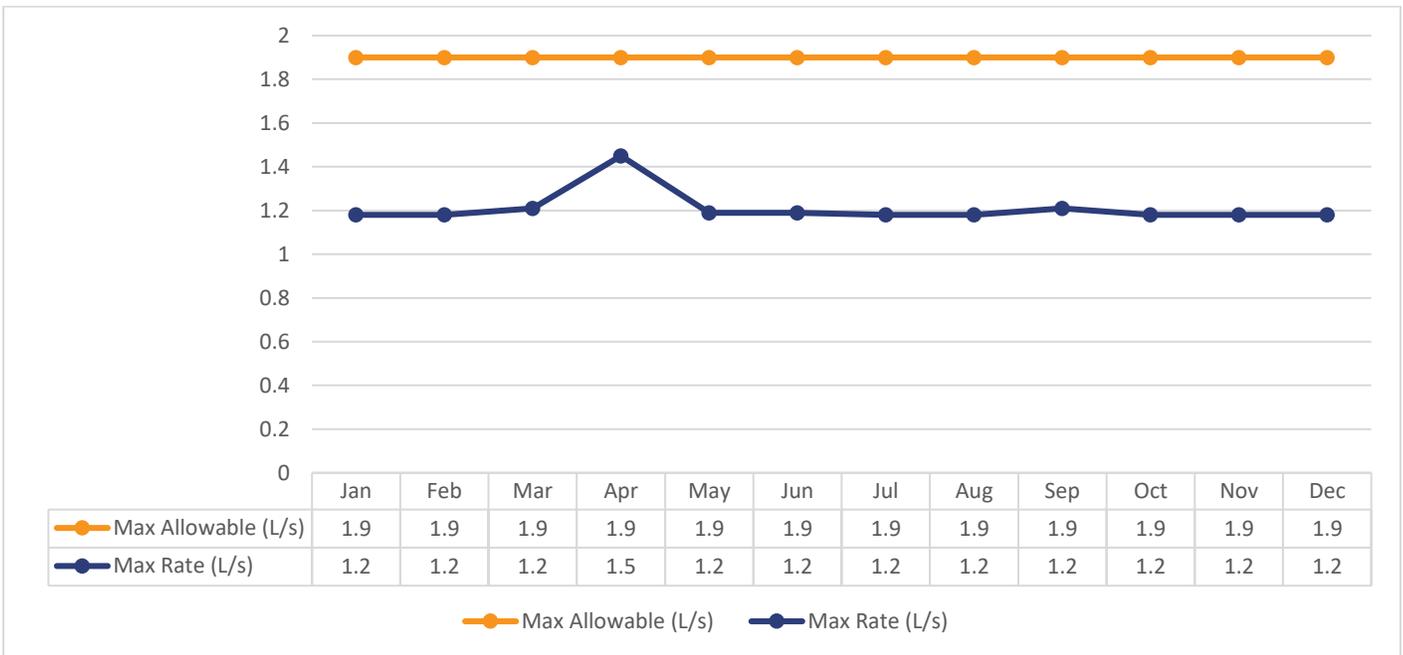


Treated Water Flows

The Treated Water flows are regulated under the Municipal Drinking Water Licence 141-116.

Graph 5. Monthly Rated Flows (m³/d) – Rated Capacity - MDWL

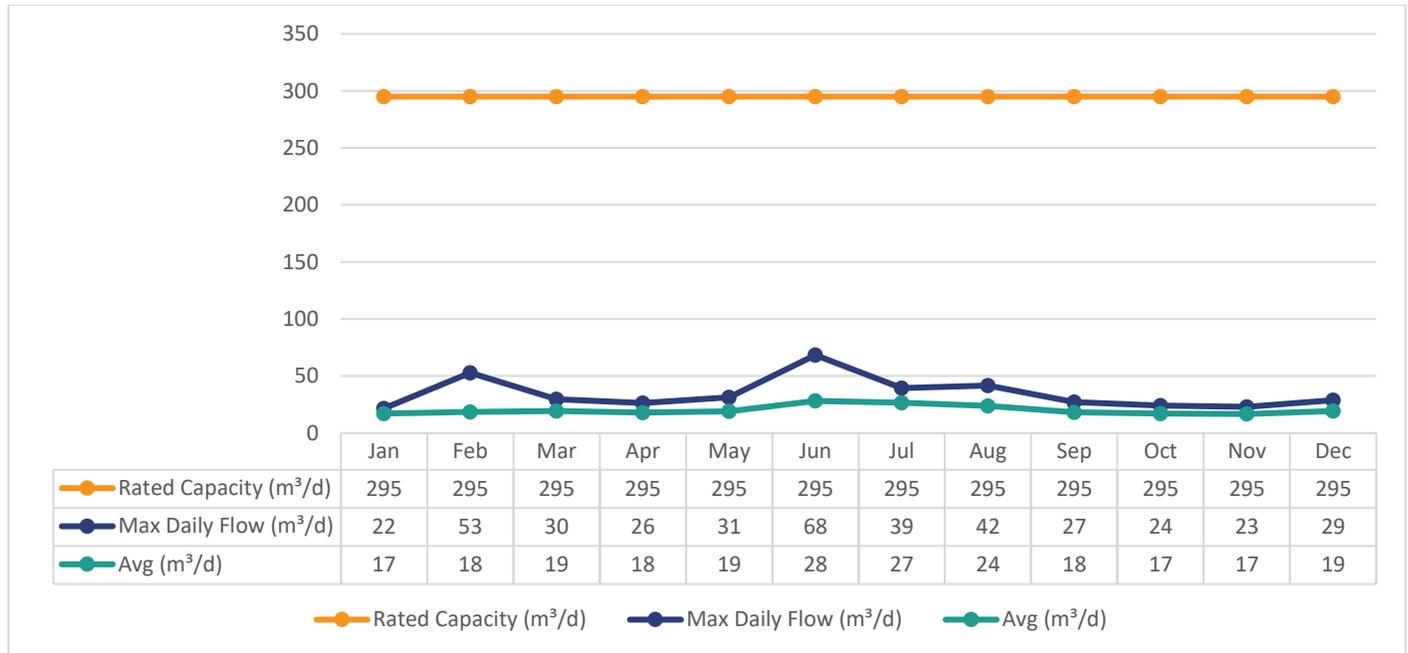

Graph 6. Annual Total Flow Comparison (m³)

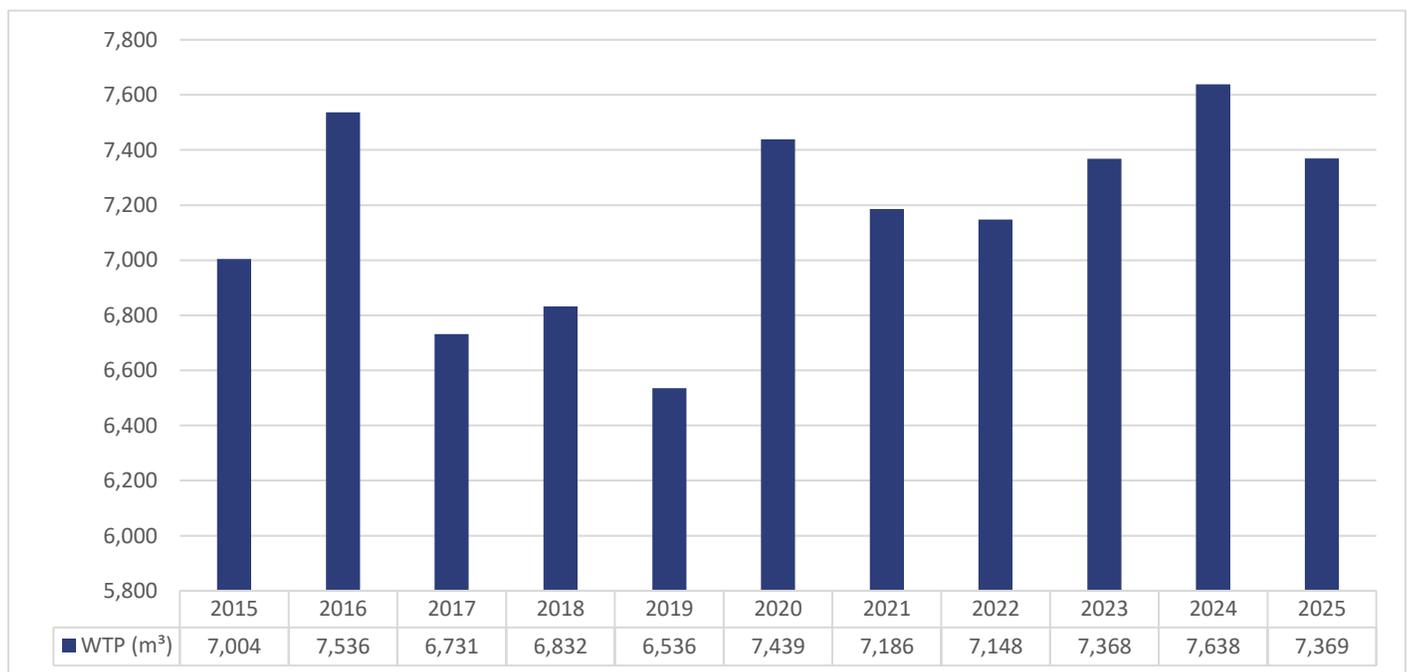

Regulatory Sample Results Summary

Microbiological Testing

Table 5. Microbiological Test Results

	Number of Samples Collected	Range of E. Coli Results	Range of E. Coli Results	Range of Total Coliform Results	Range of Total Coliform Results	Range of HPC Results	Range of HPC Results
		Min	Max	Min	Max	Min	Max
Raw Well 1	26	0	0	0	0	N/A	N/A
Raw Well 2	26	0	0	0	0	N/A	N/A
Treated	2	0	0	0	0	0	0
Distribution	60	0	0	0	0	0	4

OG = Overgrowth

HPC = Heterotrophic Plate Count

Operational Testing

Table 6. Operational Test Results

Parameter	Number of Samples Collected	Range of Results Minimum	Range of Results Maximum
Turbidity Well 1 (NTU)	12	0.17	0.54
Turbidity Well 2 (NTU)	12	0.13	0.57
Turbidity – TW (NTU)	8760	0.00	1.00
Chlorine	8760	0.16	5.00
Fluoride (If the DWS provides fluoridation)	N/A	N/A	N/A

Note: Record the unit of measurement if it is **not** milligrams per litre.

Note: For continuous monitors 8760 is used as the number of samples. Spikes recorded by online instrumentation were a result of air bubbles and various maintenance/calibration activities. All spikes are reviewed for compliance with O. Reg. 170/03, any true exceedance would be documented in this report.

Inorganic Parameters

These parameters are tested as a requirement under O. Reg. 170/03. Sodium and Fluoride are required to be tested every five years. Nitrate and Nitrate are tested quarterly and the metals are

tested every five years as required under O. Reg. 170/03. In the event any of the parameters listed in Schedule 23 or 24 of O. Reg. 170/03 exceed half of the maximum allowable concentration the parameter is required to be samples quarterly. Based on the latest test results no additional testing is required.

Table 7. Inorganic Parameters Test Results

	Sample Date (yyyy/mm/dd)	Sample Result	Unit of Measure	MAC	Exceedance
Treated Water					
Antimony	2025 01 13	<MDL 0.6	µg/L	6.0	No
Arsenic	2025 01 13	<MDL 0.2	µg/L	10.0	No
Barium	2025 01 13	212.0	µg/L	1000.0	No
Boron	2025 01 13	21.0	µg/L	5000.0	No
Cadmium	2025 01 13	<MDL 0.003	µg/L	5.0	No
Chromium	2025 01 13	0.14	µg/L	50.0	No
Mercury	2025 01 13	<MDL 0.01	µg/L	1.0	No
Selenium	2025 01 13	<MDL 0.04	µg/L	50.0	No
Uranium	2025 01 13	0.012	µg/L	20.0	No
Additional Organics					
Fluoride	2025 01 13	0.14	mg/L	1.5	No
Nitrite	2025 01 13	<MDL 0.003	mg/L	1.0	No
Nitrite	2025 04 14	<MDL 0.003	mg/L	1.0	No
Nitrite	2025 07 14	<MDL 0.003	mg/L	1.0	No
Nitrite	2025 10 14	<MDL 0.003	mg/L	1.0	No
Nitrate	2025 01 13	0.01	mg/L	10.0	No
Nitrate	2025 04 14	0.011	mg/L	10.0	No
Nitrate	2025 07 14	0.011	mg/L	10.0	No
Nitrate	2025 10 14	0.01	mg/L	10.0	No
Sodium	2025 01 13	18.1	mg/L	20*	No

MAC = Maximum Allowable Concentration as per O. Reg. 169/03

MDL = Method Detection Limit

*There is no "MAC" for Sodium. The aesthetic objective for sodium in drinking water is 200 mg/L. Sodium results exceeding 20 mg/L are to be reported to the Medical Officer of Health as per Schedule 16-3 (8) of O. Reg. 170/03.

Schedule 15 Sampling (Lead)

The Schedule 15 sampling is required under O. Reg. 170/03. This system is under reduced sampling. Only distribution samples were collected, and no plumbing samples were collected.

Table 8. Schedule 15 Test Results (Lead)

	Number of Sampling Points	Number of Samples	Range of Results Minimum	Range of Results Maximum	MAC (µg/L)	Number of Exceedances
Alkalinity (mg/L)	1	2	189	204	N/A	N/A
pH	1	2	8.21	8.29	N/A	N/A
Lead (µg/L)	N/A	N/A	N/A	N/A	10.0	N/A

Organic Parameters

These parameters are tested as a requirement under O. Reg. 170/03. In the event any of the parameters listed in Schedule 23 or 24 of O. Reg. 170/03 exceed half of the maximum allowable concentration the parameter is required to be samples quarterly. Based on the latest test results no additional testing is required.

Table 9. Organic Parameters Test Results

	Sample Date (yyyy/mm/dd)	Sample Result	Unit of Measure	MAC	Exceedance
Treated Water					
Alachlor	2025 01 13	<MDL 0.02	µg/L	5.0	No
Atrazine + N-dealkylated metabolites	2025 01 13	<MDL 0.01	µg/L	5.0	No
Azinphos-methyl	2025 01 13	<MDL 0.05	µg/L	20.0	No
Benzene	2025 01 13	<MDL 0.32	µg/L	1.0	No
Benzo(a)pyrene	2025 01 13	<MDL 0.004	µg/L	0.01	No
Bromoxynil	2025 01 13	<MDL 0.33	µg/L	5.0	No
Carbaryl	2025 01 13	<MDL 0.05	µg/L	90.0	No
Carbofuran	2025 01 13	<MDL 0.01	µg/L	90.0	No
Carbon Tetrachloride	2025 01 13	<MDL 0.17	µg/L	2.0	No
Chlorpyrifos	2025 01 13	<MDL 0.02	µg/L	90.0	No
Diazinon	2025 01 13	<MDL 0.02	µg/L	20.0	No
Dicamba	2025 01 13	<MDL 0.2	µg/L	120.0	No
1,2-Dichlorobenzene	2025 01 13	<MDL 0.41	µg/L	200.0	No
1,4-Dichlorobenzene	2025 01 13	<MDL 0.36	µg/L	5.0	No
1,2-Dichloroethane	2025 01 13	<MDL 0.35	µg/L	5.0	No
1,1-Dichloroethylene	2025 01 13	<MDL 0.33	µg/L	14.0	No

	Sample Date (yyyy/mm/dd)	Sample Result	Unit of Measure	MAC	Exceedance
Dichloromethane (Methylene Chloride)	2025 01 13	<MDL 0.35	µg/L	50.0	No
2,4-Dichlorophenol	2025 01 13	<MDL 0.15	µg/L	900.0	No
2,4-Dichlorophenoxy acetic acid (2,4-D)	2025 01 13	<MDL 0.19	µg/L	100.0	No
Diclofop-methyl	2025 01 13	<MDL 0.4	µg/L	9.0	No
Dimethoate	2025 01 13	<MDL 0.06	µg/L	20.0	No
Diquat	2025 01 13	<MDL 1.0	µg/L	70.0	No
Diuron	2025 01 13	<MDL 0.03	µg/L	150.0	No
Glyphosate	2025 01 13	<MDL 1.0	µg/L	280.0	No
Malathion	2025 01 13	<MDL 0.02	µg/L	190.0	No
2-Methyl-4- chlorophenoxyacetic Acid (MCPA)	2025 01 13	<MDL 0.12	µg/L	100.0	No
Metolachlor	2025 01 13	<MDL 0.01	µg/L	50.0	No
Metribuzin	2025 01 13	<MDL 0.02	µg/L	80.0	No
Monochlorobenzene (Chlorobenzene)	2025 01 13	<MDL 0.3	µg/L	80.0	No
Paraquat	2025 01 13	<MDL 1.0	µg/L	10.0	No
PCB	2025 01 13	<MDL 0.04	µg/L	3.0	No
Pentachlorophenol	2025 01 13	<MDL 0.15	µg/L	60.0	No
Phorate	2025 01 13	<MDL 0.01	µg/L	2.0	No
Picloram	2025 01 13	<MDL 1.0	µg/L	190.0	No
Prometryne	2025 01 13	<MDL 0.03	µg/L	1.0	No
Simazine	2025 01 13	<MDL 0.01	µg/L	10.0	No
Terbufos	2025 01 13	<MDL 0.01	µg/L	1.0	No
Tetrachloroethylene	2025 01 13	<MDL 0.35	µg/L	10.0	No
2,3,4,6- Tetrachlorophenol	2025 01 13	<MDL 0.2	µg/L	100.0	No
Triallate	2025 01 13	<MDL 0.01	µg/L	230.0	No
Trichloroethylene	2025 01 13	<MDL 0.44	µg/L	5.0	No
2,4,6-Trichlorophenol	2025 01 13	<MDL 0.25	µg/L	5.0	No
Trifluralin	2025 01 13	<MDL 0.02	µg/L	45.0	No
Vinyl Chloride	2025 01 13	<MDL 0.17	µg/L	1.0	No
Distribution Water					
Trihalomethane Total Annual Average Q1	2025 01 13	23.00	µg/L	100.0	No
Trihalomethane Total Annual Average Q2	2025 04 14	22.00	µg/L	100.0	No
Trihalomethane Total Annual Average Q3	2025 07 14	24.00	µg/L	100.0	No

	Sample Date (yyyy/mm/dd)	Sample Result	Unit of Measure	MAC	Exceedance
Trihalomethane Total Annual Average Q4	2025 10 14	24.00	µg/L	100.0	No
HAA Total Annual Average Q1	2025 01 13	<MDL 5.3	µg/L	80.0	No
HAA Total Annual Average Q2	2025 04 14	<MDL 5.3	µg/L	80.0	No
HAA Total Annual Average Q3	2025 07 14	<MDL 5.3	µg/L	80.0	No
HAA Total Annual Average Q4	2025 10 14	<MDL 5.3	µg/L	80.0	No

MAC = Maximum Allowable Concentration as O. Reg. 169/03

MDL = Method Detection Limit

Additional Legislated Samples

There were no additional legislated samples required to report during this reporting period.

Minor Maintenance

- Generator Low Oil Pressure, Repair
- Diesel Generator Low Oil Pressure, Repair
- Troubleshoot and Repair Generator Fault, Low Coolant Temp Alarm

Major Maintenance Expense (above \$10,000)

Under Section 11 of O. Reg. 170/03, a description of any major expenses incurred during this reporting period to install, repair or replace required equipment must be included in the annual report. The details of the major expenses for this drinking water system are as follows:

Nothing to report for the reporting period.

APPENDIX A

WTR Submission Confirmation



Ministry of the Environment,
Conservation and Parks

| [WT DATA](#) | [USER PROFILE](#) | [CONTACT US](#) | [HELP](#) | [HOME](#) | [LOGOUT](#) |

Location: [WTRS](#) / [WT DATA](#) / [Input WT Record](#)

WTRS-WT-008

Water Taking Data submitted successfully.

Confirmation:

Thank you for submitting your water taking data online.

Permit Number: 8680-AYSHVM
Permit Holder: THE CORPORATION OF THE CITY OF KAWARTHA LAKES.
Received on: Feb 17, 2026 11:14 AM

This confirmation indicates that your data has been received by the Ministry, but should not be construed as acceptance of this data if it differs from that specified on the Permit Number, assigned to the Permit Holder stated above.

[Print Confirmation](#)

[Return to Main Page](#)

CITY OF KAWARTHA LAKES | 2026/02/17
version: v5.0.0.01 (build#: 28)
Last modified: 2021/09/22