
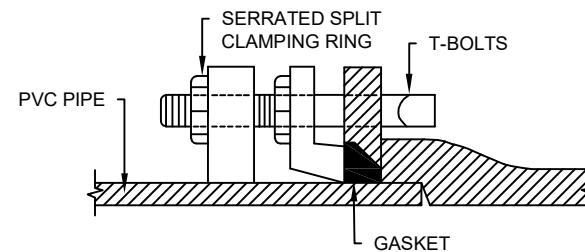



**FLANGE JOINT UNI-FLANGE SERIES 900 RESTRAINER
OR APPROVED EQUIVALENT 100mm TO 300mm**

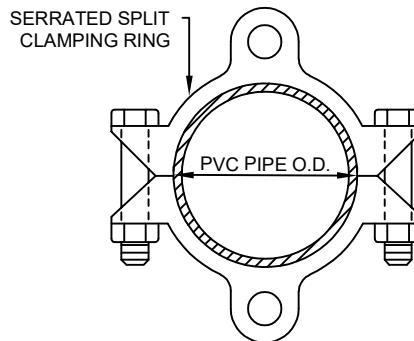

**MECHANICAL JOINT UNI-FLANGE SERIES 1300 RESTRAINER OR
APPROVED EQUIVALENT 100mm TO 400mm**

NOTES:

1. ALL BOLTS AND NUTS SHALL BE CORE-TEN STEEL OR EQUIVALENT.
2. REFER TO STANDARD DETAIL DRAWING CKL-104 FOR LENGTH OF JOINTS TO BE RESTRAINED.
3. ANY CONNECTION TO OTHER FLANGED PIPE REQUIRES AN ADDITIONAL RESTRAINER TO THE PVC PIPE.
4. ALL JOINTS SHALL BE RESTRAINED IN ENGINEERED FILL APPLICATIONS.

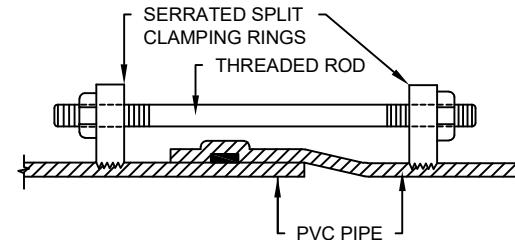

**BELL JOINT UNI-FLANGE SERIES 1350
RESTRAINER OR APPROVED
EQUIVALENT 100mm TO 400mm**

NO.	COMMENTS	BY	DATE	APPROVED BY	APPROVED DATE
1	NOTES AND TITLE BLOCK UPDATE	BC	2021/04/27		