



T-INTERSECTION

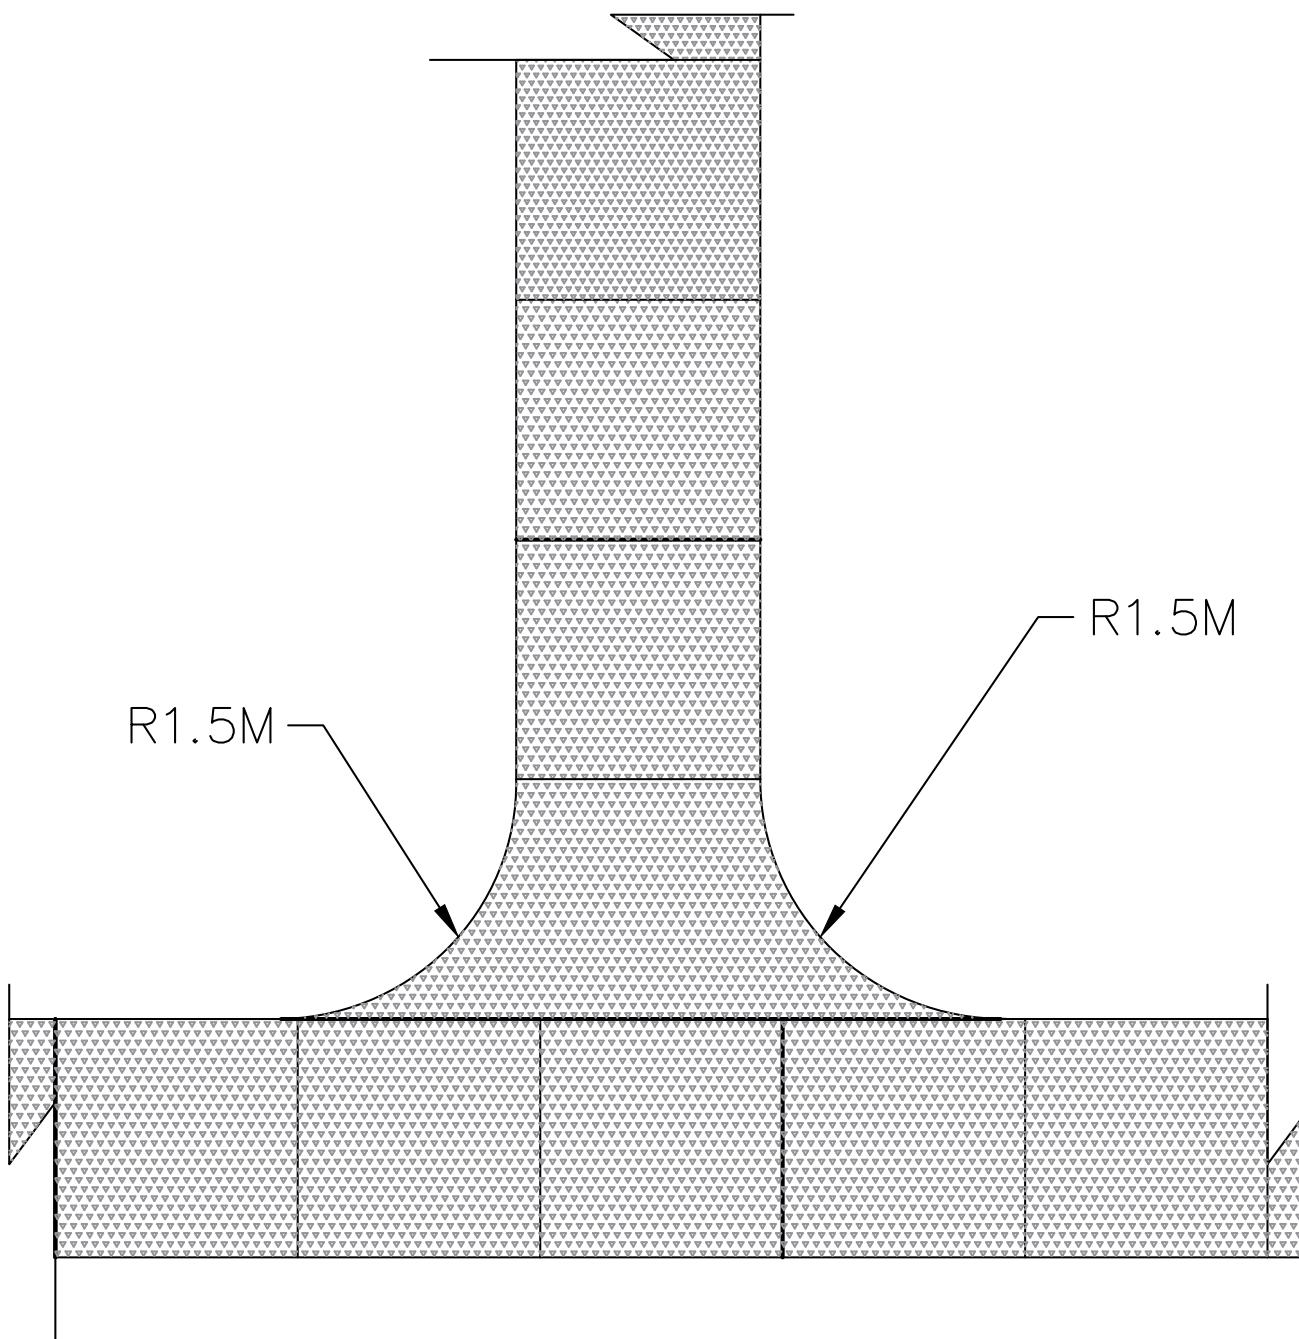

90° INTERSECTION

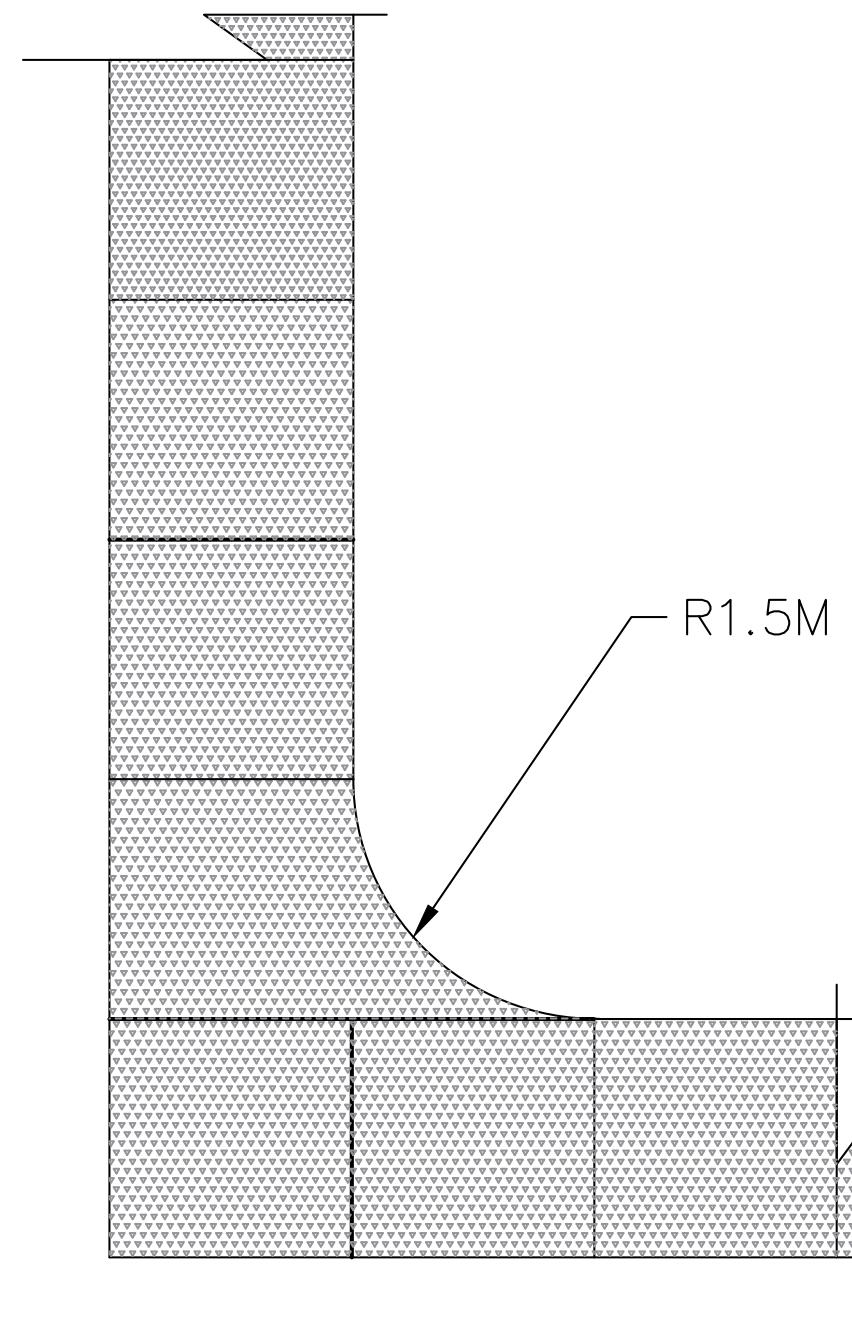

NOTES:

1. ALL SIDEWALKS ARE TO BE DESIGNED IN ACCORDANCE WITH OPSD 310.010 EXCEPT WHERE CONTRADICTED BY THIS DRAWING.
2. ALL SIDEWALKS ARE TO CONSIST OF 125mm OF 32MPa COMPRESSIVE STRENGTH CONCRETE WITH A 150mm THICKNESS GRANULAR 'A' BASE COMPACTED TO 100% SPMDD. AT ALL COMMERCIAL, INDUSTRIAL, AND APARTMENT ENTRANCES SIDEWALKS ARE TO BE INCREASED IN THICKNESS TO 200mm AND SHALL HAVE WELDED WIRE REINFORCEMENT INSTALLED.
3. 5mm SAW CUT DUMMY JOINTS ARE TO BE PLACED TO PROVIDE PANELS AS SQUARE AS POSSIBLE AND 0.25 DEPTH SAW CUT CONTRACTION JOINTS SHALL BE PLACED AT EVERY THIRD DUMMY JOINT. 12mm EXPANSION JOINTS SHALL BE PLACED AT ALL SIDEWALK INTERSECTIONS.

STANDARD SIDEWALK INTERSECTIONS

**CITY OF KAWARTHA LAKES
ENGINEERING AND CORPORATE
ASSETS**

322 KENT ST. W, Box 9000, LINDSAY ON. K9V 4T7, (705) 324-9411

DRAWN BY:AK CHECKED BY: CT DATE: 2025/11/19

DATE 2020/01/01

Kawartha Lakes

CONTRACT NO:
SCALE: 1: 50
PAGE 1 OF 1
DRAWING NO.
CKL - 410